



Presentation to

MWRA Board of Directors

Lead and Copper Rule Changes and Recommendations

February 21, 2024



Significant Changes to the Lead and Copper Rule

- DRAFT Lead and Copper Rule Improvements (LCRI)
 - Issued December 2023
 - Expected FINAL October 2024; Effective October 2027
- Builds On and Modifies/Defers the LCR Revisions (LCRR)
- Key LCRR Requirements Still Due October 16, 2024
 - Service Line Inventory
 - Related Outreach
 - 24-Hour Public Notice if over Action Level



LCRI Changes

- All systems must replace all lead service lines within 10 years
 - Regardless of lead sample results
- Lower Action Level from 15 ppb to 10 ppb
 - More systems will exceed
- Changes to sampling and compliance calculation
 - Reported levels will be higher
- More stringent requirements if over Action Level 3 times in 5 years
 - More outreach
 - Offer filters to all customers




Option to Defer Change to Corrosion Treatment

- If MWRA exceeds the lead Action Level, we must re-optimize corrosion control treatment
 - Most likely option is adding orthophosphate
- Estimated capital and operating costs - \$60 to \$80 million
- LCRI offers an option to accelerate lead service line replacement rather than change corrosion control treatment
 - Replace all LSL within 5 years at 20% per year
 - Defer action on treatment changes while in process




System – wide results

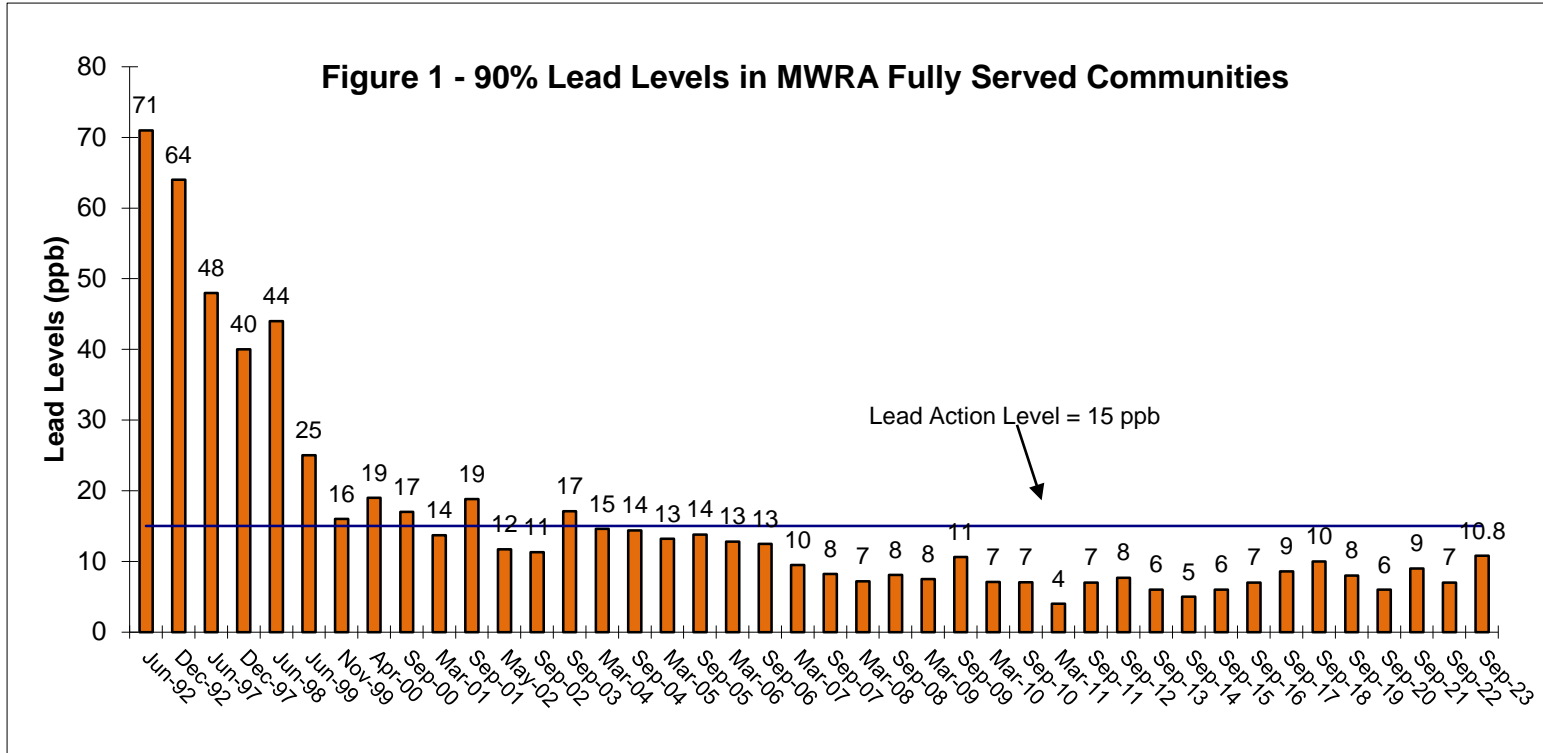




System – wide results

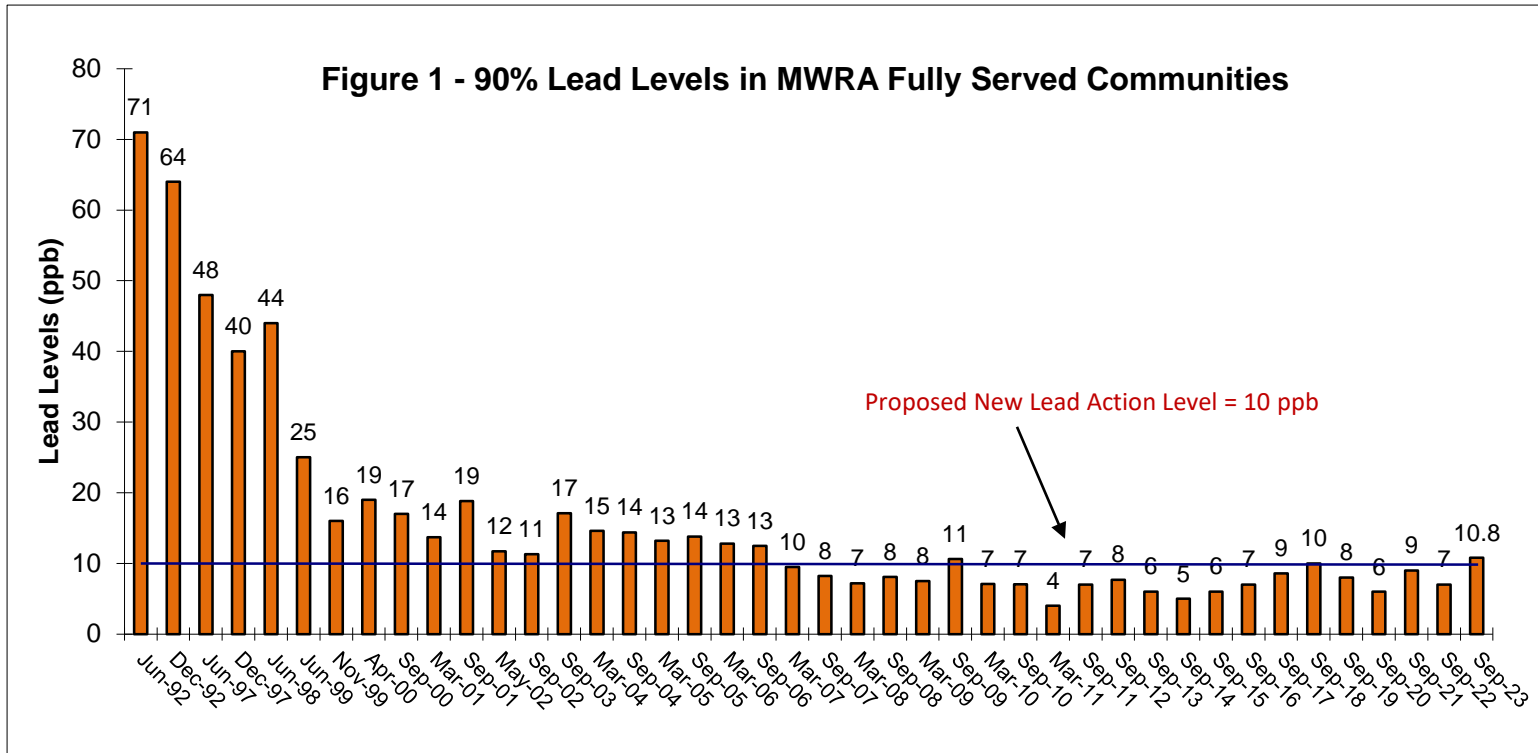



2023 Sampling Results – 10.8 ppb

2023 Sampling Round Results

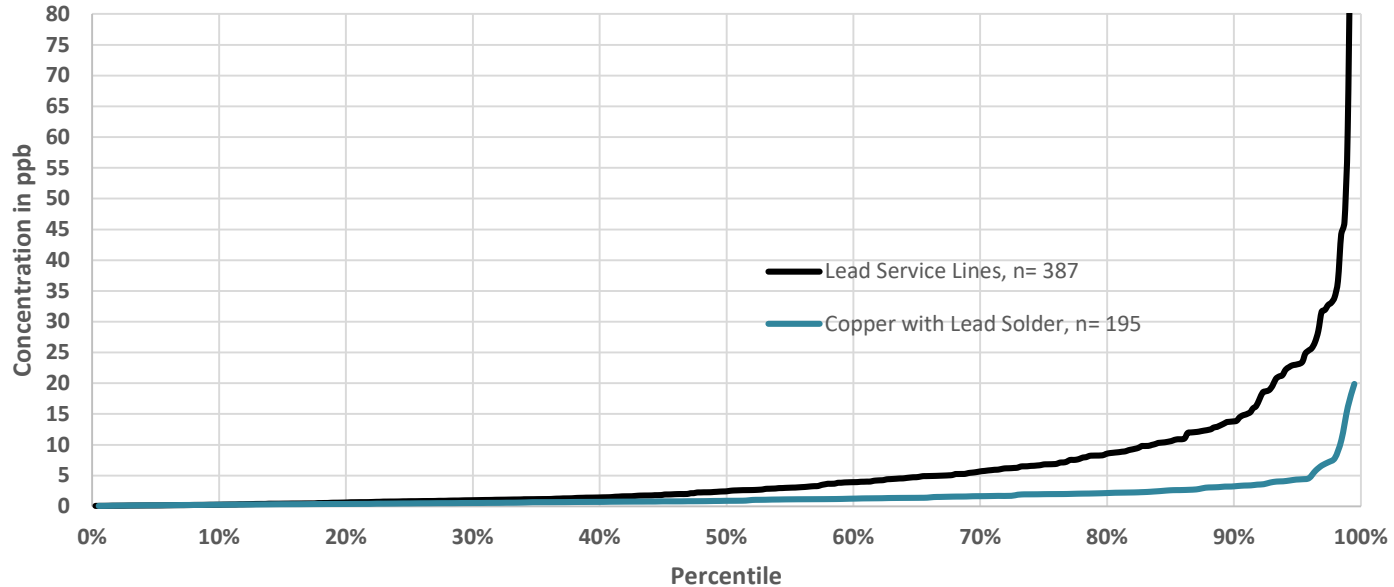

Type	Median	75 th Percentile	90 th Percentile	95 th Percentile	% of Total
LSL	2	7	13	23	65
CULS	1	2	3	4	33



90th Percentile Results Significantly Lower for Non LSL Sites

Year	2018	2019	2020	2021	2022	2023
90th Percentile Full system	10	8	6	9	7	11
90th Percentile Just LSL	12	11	8	13	9	14
90th Percentile Just Lead Solder	3	3	2	3	2	3

Red shows results over proposed new Action Level of 10 ppb



Most high values from sites with lead service lines

- In 2023 sampling round:
 - 35 of 595 samples were over the action level
 - 31 of the 35 were from sites with lead service lines
- In 2022 sampling round:
 - 18 of 595 samples were over the action level
 - 17 of the 18 were from sites with lead service lines



MWRA's Zero-Interest Lead Service Line Loan Program

- \$100 Million loan program approved in 2016
- Provided \$41 million in loans to 17 communities
- Current best estimate of remaining lead services is 15,400 (2.9%)
- Estimated total cost - \$150 million
- Better data available this October



Potential Program Changes to Accelerate Replacement

- Demonstrate MWRA commitment to full replacement
 - Fully fund program with additional \$100 million phase
- Facilitate private side replacement with 25 percent grant portion
 - Estimated cost \$40 million
- Significant outreach effort to ensure local participation
- Required completion date – 2033, assuming LCRI in effect in 2027



Presentation to


MWRA Board of Directors

Top of Shaft 5 Interim Improvements Contract 7671

February 21, 2024



Top of Shafts Interim Improvements – All Sites

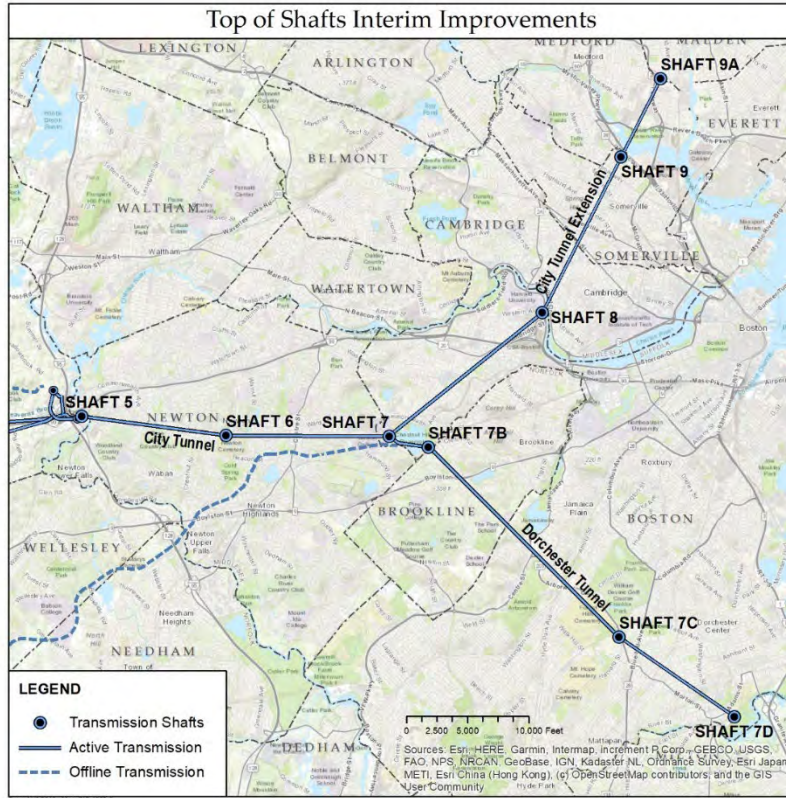

Improve and protect critical facilities related to the existing tunnel system at nine shaft locations:

- **Shaft 5 – Weston (this contract)**
- *Shaft 6 – Newton (complete)*
- *Shaft 8 – Brighton (complete)*
- *Shaft 9A – Malden (complete)*
- Shaft 7 – Boston College (in design)
- Shaft 7B – Chestnut Hill (in design)
- Shaft 7C – Dorchester (in design)
- Shaft 7D – Dorchester (in design)
- Shaft 9 – Somerville (future)

*without taking system out of service



Top of Shaft 5 Interim Improvements



Multiple valve vaults (corrosion protection, bolt replacement, and vault waterproofing)



Underground pump room (abandoned with fill)

Significant Project Constraints: Work via confined space entry; No work during summer demand period; Labor intensive work



Top of Shaft 5 Interim Improvements – Procurement Process

Proposals Opened on January 24, 2024:

<u>Bidder</u>	<u>Amount</u>
R. Zoppo Corp.	\$5,361,500
<i>Engineer's Estimate</i>	<i>\$5,483,000</i>
D'Allessandro Corp.	\$8,442,750
WES Construction	\$11,440,750

Contract Duration: 30 Months



Presentation to


MWRA Board of Directors

***MWRA Fiscal Year 2025 Proposed
Current Expense Budget***

February 21, 2024



FY25 Proposed CEB – Budget Structure

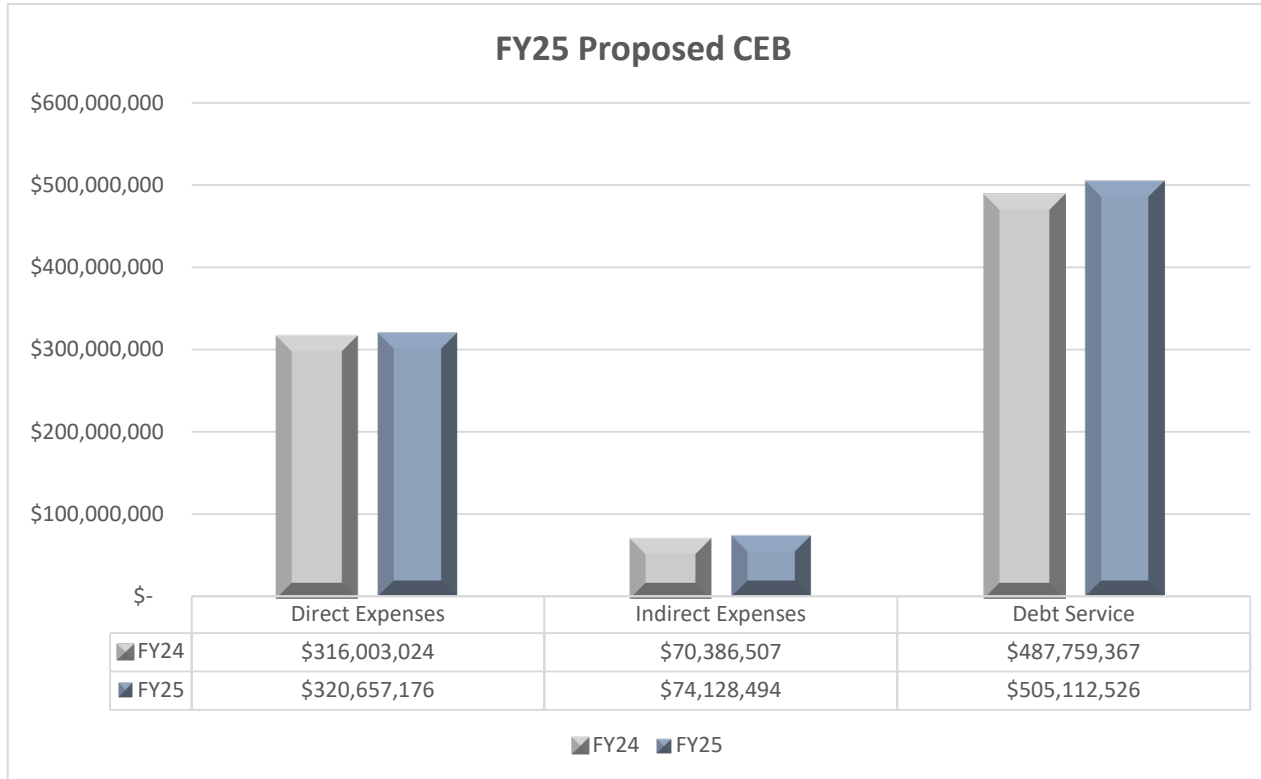



- **Direct Expenses:** Increase of \$4.7 million or 1.5% driven by Chemicals, Wages & Salaries, and Maintenance.
- **Indirect Expenses:** Increase of \$3.7 million or 5.3% driven by Pension, Reserve Changes, and Watershed Reimbursement.
- **Debt Service:** Increase of \$17.4 million or 3.6% driven by the structure of new and existing debt.



FY25 Proposed CEB – Rate Projections (Combined)


**MWRA Combined Utilities
Historical and Projected Rate Revenue Changes**

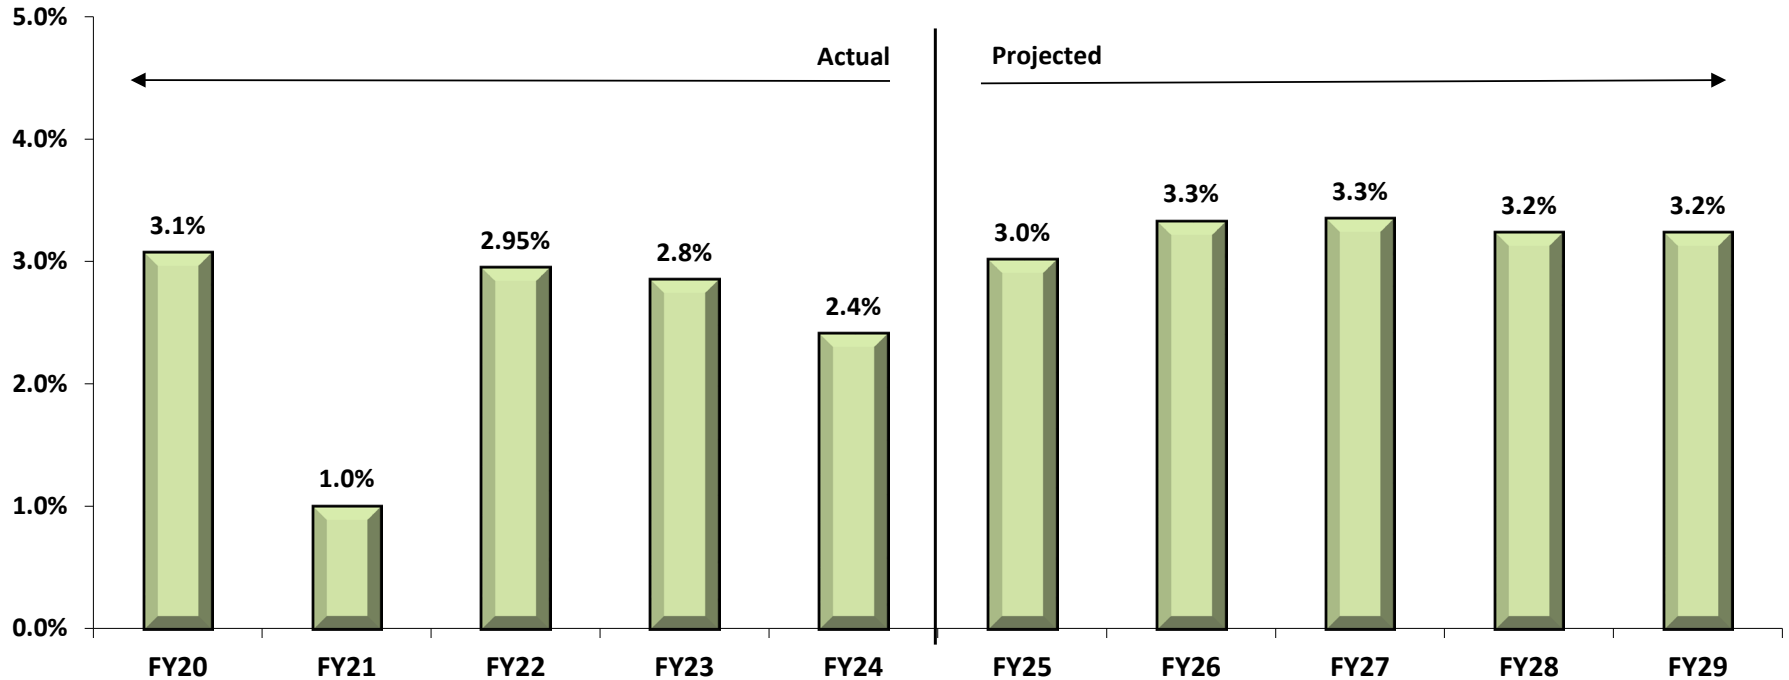



FY25 Proposed CEB – Rate Projections (By Utility)

MWRA Water & Sewer Utilities
Historical and Projected Rate Revenue Changes

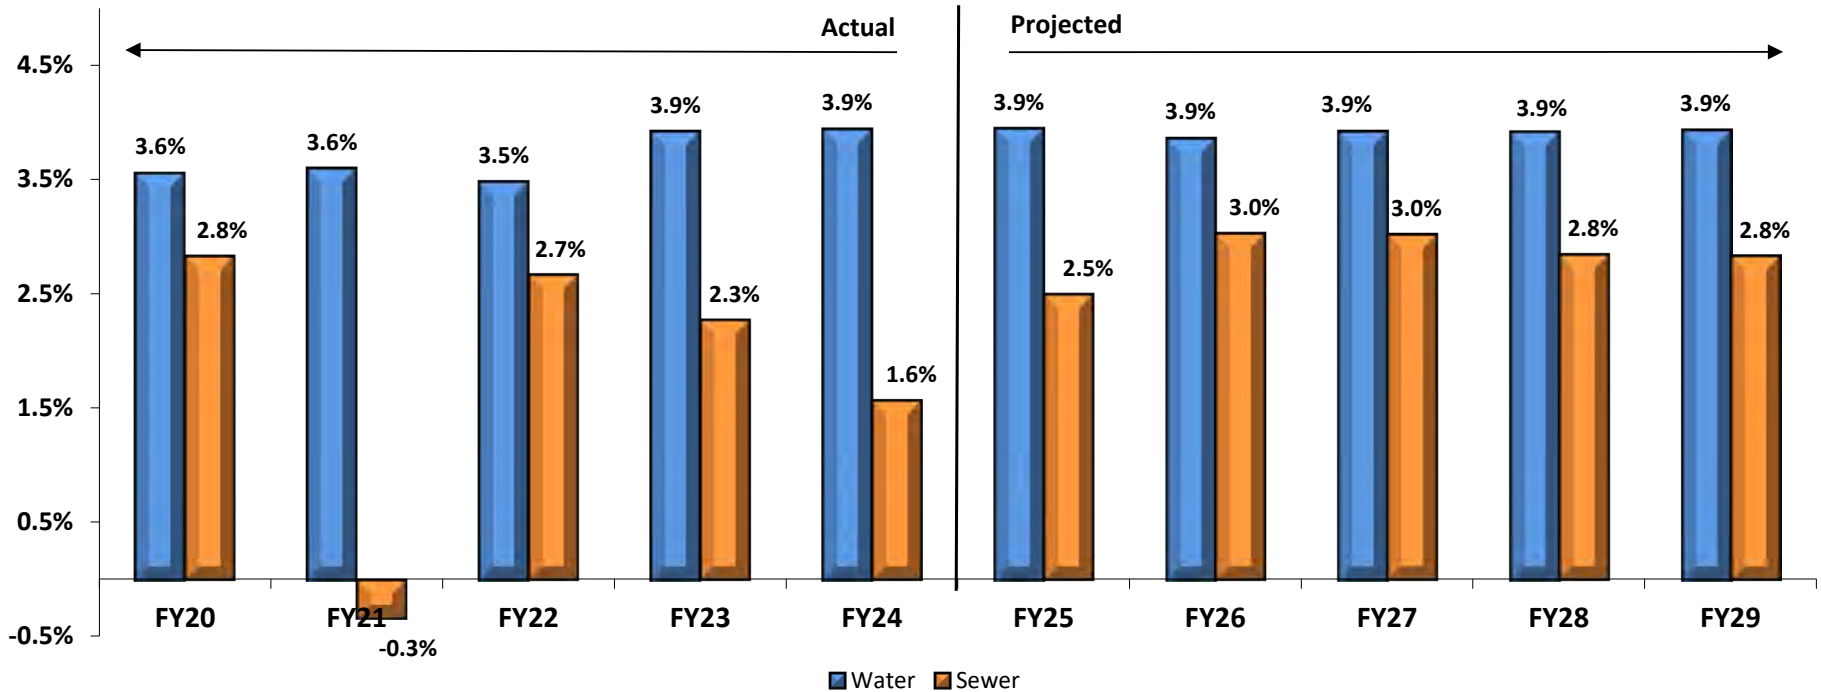



FY25 Proposed CEB – Next Steps

- Transmit Proposed Budget to Advisory Board for their 60-day minimum comment and review period
- Spring Revisit Process/Provide briefings to Advisory Board Staff
- Public Hearing in April
- MWRA Board Hearing in May
- Staff anticipate FY25 Budget adoption in June



Presentation to

MWRA Board of Directors


Purchase and Supply of Electricity for the Deer Island Treatment Plant

February 21, 2024




MWRA Electricity Contracts Overview

% Total MWRA Load (156M kWh/yr)

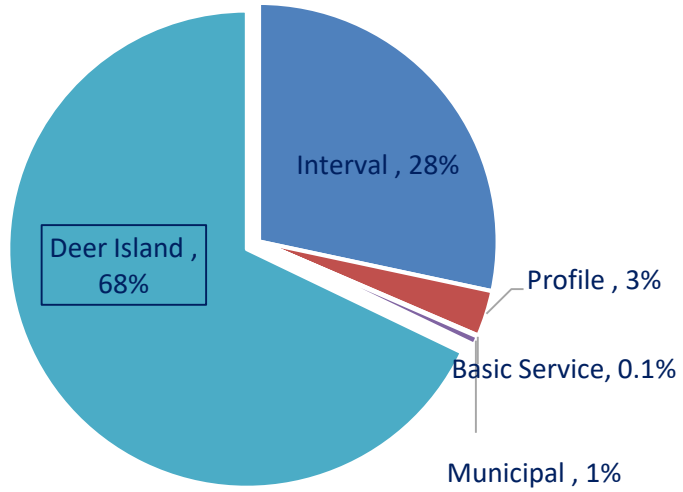

% Total MWRA Budget (\$22M)

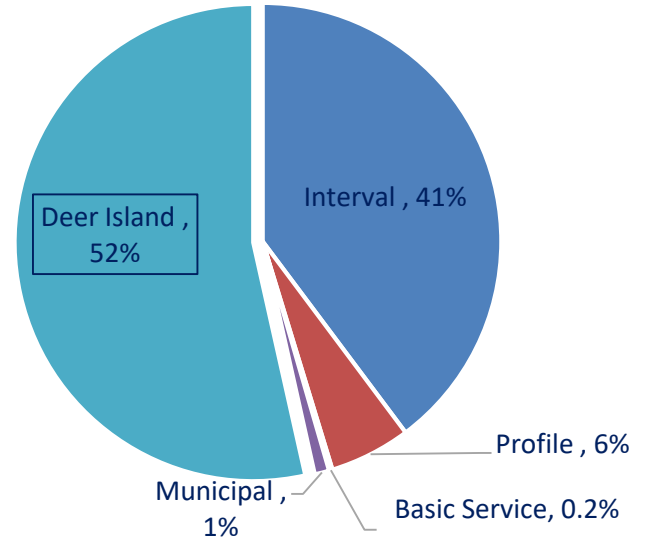



Presentation to

MWRA Board of Directors

*Oxygen Generation Facility Services
Contract S587, Amendment 2*

February 21, 2024



DITP – Cryogenic Oxygen Generation Facility



- Provides oxygen to microorganisms in secondary treatment (95% Purity)
- Critical to core mission of NPDES permit compliance
- Specialized knowledge required for maintenance
- Hundreds of instruments requiring calibration for efficient operation



DITP – Cryogenic Oxygen Generation Facility



4 Large Air Compressors (2 @ 2,000hp, 2 @ 2500 hp)



2 Molecular Sieves



2 Cold Boxes



1,000 Ton Liquid Oxygen Storage



Instrumentation & Controls



Bidding History

- Limited qualified contractors bid in past
- Solutionwerks Inc. has held this contract from 2005-08, and then 2011-present
- Only other bidders:
 - Mixing & Mass Transfer Tech – awarded 2008 (No longer support Oxygen facility maintenance)
 - Ranch Cryogenics (last bid 2017)



Reasons for Extension

- Notice from existing vendor caused staff to re-evaluate contract strategy
- Successor contract will include additional maintenance/corrective work:
 - Bidding under C. 149
 - Potential to draw more contractors to bid
- Contract extended under delegated authority to develop bid documents
- Extra time needed:
 - to research specialty equipment requirements
 - to add Programmable Logic Controller upgrades