



Massachusetts Water Resources Authority

SEPTEMBER 15, 1997

WATER QUALITY UPDATE

An analysis of August, 1997 water sampling data.

In this Issue . . .

August 1997 Sampling Data p. A-F

A Special Supplement on:

Total Trihalomethanes (THMs)

This is a periodic report containing important information about the quality of water supplied by MWRA. We hope this report is useful to you as a local water supplier, public health official, water consumer or observer of MWRA's system performance.

MWRA provides about 250 million gallons of water each day to 46 cities and towns in eastern and central Massachusetts. Each municipality is responsible for distributing the water in its own community. Twenty-five of the customer communities are fully supplied by MWRA. The other communities use MWRA water to augment their own supplies, either on a regular basis or in times of water shortage. More than two million people are served by the MWRA water supply system.

THE WATER SYSTEM

Quabbin Reservoir is the primary source of water for our system and one of the country's largest water supply impoundments with a capacity of 412 billion gallons. Water is transferred from the Quabbin Reservoir to the 65 billion gallon Wachusett Reservoir in Clinton via the Quabbin Aqueduct. The watersheds serving the Quabbin and Wachusett Reservoirs total 294 square miles. MWRA and the Metropolitan District Commission (MDC) are committed to protection of the water supply through aggressive watershed management as the first line of defense against water contamination.

Water is next piped from the Wachusett Reservoir to Norumbega and Weston Reservoirs in Weston via the Hultman and Weston Aqueducts respectively. Most municipalities in the MWRA service area receive drinking water distributed directly from the Hultman Aqueduct, the Norumbega Reservoir and the Weston Reservoir. Six communities are supplied from Spot Pond and from Fells Reservoirs.

INDICATORS OF WATER QUALITY

MWRA routinely uses six general indicators of water quality:

- Microbial (bacteria and algae)
- Turbidity
- Corrosiveness (pH and alkalinity)
- Disinfectant
- Chemical (inorganic and organic)
- Radionuclides

Tests are conducted on water sampled at the source reservoirs (source water) and also on water after treatment sampled from MWRA or community lines (treated water). Testing frequencies vary by parameter.

Microbial: Algal levels in reservoirs are monitored by MDC and MWRA. These results, along with taste and odor complaints, are used to make decisions on source water treatment for algae control.

Total coliform bacteria are monitored in both source and treated water to provide an indication of overall bacteriological activity. Since many members of the coliform bacteria group originate from the non-intestinal environment, such as soil, many coliform are harmless. A subclass of the coliform group which are identified by their growth at temperatures consistent with intestinal environments, the "fecal coliform bac-

For more information, please contact **MWRA Public Affairs at (617) 242-6000**

100 First Avenue, Charlestown Navy Yard, Boston, MA 02129.

For further information regarding health concerns, please contact the **Department of Public Health/Division of Epidemiology at (617) 983-6800** or **Boston Health and Hospitals at (617) 534-5611.**

teria," are indicators of possible intestinal contamination. *Escherichia coli* (*E. coli*) is a specific coliform species that is almost always present in fecal material and whose presence indicates likely bacterial contamination of intestinal origin.

Turbidity: Turbidity is a measure of suspended and colloidal particles including clay, silt, organic and inorganic matter, algae and microorganisms. The effects of turbidity depend on the nature of the matter which causes the turbidity. Particulate matter may have a chlorine demand or may protect bacteria from the disinfectant effects of chlorine, thereby interfering with the maintenance of a disinfectant residual throughout the distribution system.

Corrosiveness: In order to minimize the leaching of lead and copper in plumbing systems, the pH, or corrosivity, is monitored and adjusted. Water provided by MWRA is basically lead free when it leaves the reservoirs but individual building service lines that carry water from street mains, as well as household plumbing fixtures, can contain lead that is susceptible to corrosion and leaching into tap water. In June 1996, MWRA's Interim Corrosion Control (ICC) facility in Marlborough went on-line. MWRA believes the ICC provides the optimal corrosion control treatment now achievable for all MWRA customer communities east of and including Marlborough. The chemicals sodium carbonate (soda ash) and CO₂ (carbon dioxide) are added to increase the pH and buffering capacity of the water which should considerably reduce the lead levels found when you first use your tap.

Disinfectant: MWRA treats the water supplied to metropolitan Boston area communities using disinfection facilities at Quabbin, Norumbega, Weston, Spot Pond and Fells Reservoirs. At Norumbega and Weston Reservoirs, chlorine is used to inactivate pathogens coming from source waters and, with the further addition of ammonia, chloramines are formed to establish a sufficient level of residual disinfectant to protect against any new contaminants that may enter the distribution system. In the communities served by Spot Pond and Fells Reservoirs, chlorine is added to protect against contamination that may have entered the water locally at these open surface reservoirs. The water fed downstream of these sources has a free chlorine residual. Some communities in the furthest parts of the MWRA delivery system also

rechlorinate as added protection.

Chemical: Inorganics and nitrates are measured at Quabbin and Wachusett Reservoirs. Analyses of disinfection byproducts such as trihalomethanes are performed at seven locations throughout the distribution system. Volatile organic compounds are measured at the distribution reservoirs: Norumbega, Weston and Spot Pond. Synthetic organic compounds are measured at Wachusett Reservoir. MWRA generally meets applicable standards.

Radionuclides: Radionuclides are measured at three distribution locations. MWRA generally meets applicable standards.

SAMPLING AND ANALYSIS

MWRA conducts all water sampling and testing required by federal and state law. We also conduct baseline and periodic research to help us improve water quality. Results of testing are compared to standards and guidelines prepared by DEP and recommendations for further action are made if reported levels are above the standards.

Source water: MWRA collects samples from the source water supply and reservoirs which are tested for coliform bacteria, turbidity, pH, chemical constituents and radionuclides.

Treated water: MWRA collects treated water samples throughout the system and conducts tests for pH, temperature, primary disinfectant levels, disinfectant residual and coliform bacteria. In addition, customer communities routinely collect treated water samples in compliance with federal Safe Drinking Water Act (SDWA) testing requirements including the Total Coliform Rule. These samples are analyzed for disinfectant residual and coliform bacteria.

Communities may bring their samples to the MWRA Water Quality Laboratory for analysis, or they may have samples analyzed elsewhere. MWRA Laboratories test samples for all customer communities except Bedford, Cambridge, Canton, Chicopee, Clinton, Leominster, Lynn, Marlborough, Northborough, Peabody, South Hadley, Wilbraham, Woburn and Worcester. Community data for these communities are not presented in this report.



Massachusetts Water Resources Authority

SEPTEMBER 15, 1997

A SPECIAL SUPPLEMENT TO THE SEPTEMBER ISSUE OF WATER QUALITY UPDATE

TOTAL TRIHALOMETHANES (THMs)

MWRA uses chlorine to disinfect the source water to inactivate pathogens that may be present. When naturally occurring organic material or precursors are present in the water, the formation of trihalomethanes (THMs) and other disinfection by products (DBPs), such as haloacetic acids (HAAs), is possible and it is dependent on pH, temperature, concentration of precursors and disinfectant, reaction rates, and travel time. Some of these compounds are of concern in drinking water because they are known or suspected carcinogens when consumed over long periods of time.

Current standards for THMs in drinking water are 100 ug/l (micrograms per liter, or parts per billion, ppb) based on the average of four quarterly samples. New regulations are being developed, and the "Stage I" requirements for THMs are expected to be 80 ug/l. Also expected to be regulated in the Stage I standards are HAAs at 60 ug/l.

Because MWRA uses both chlorine and ammonia (chloramines) to disinfect the water, the formation of THMs and other DBPs is minimized. The ammonia combines with the chlorine and chloramines have a much slower reaction rate with organic precursors.

MWRA is currently in full compliance with the standards for trihalomethanes. On a quarterly basis, samples are collected from seven locations throughout the MWRA service area. Results are presented on the reverse side of this page. THM formation is higher in South Lynnfield because this community rechlorinates using free chlorine. Even in this case, THMs are well below the standard. MWRA will work with commu-

nity water departments, particularly those that rechlorinate, to assist them in modifying their treatment practices to minimize the formation of DBPs.

Improvements to current disinfection are necessary to provide higher inactivation rates of pathogens that may be present in the source water. As MWRA implements improvements by providing chlorination at Cosgrove Intake/Wachusett Reservoir, there will be an increase in THM levels. MWRA will continue to monitor levels throughout the water system to ensure continued compliance with the standard. Based on laboratory test results, it is expected that MWRA will be in full compliance with the Proposed Stage I regulations for both THMs and HAAs.

MAXIMUM CONTAMINANT LEVELS (MCLs)

STAGE	THM	HAA
Current	100 ug/l	no standard
Stage I (proposed 2001)	80 ug/l	60 ug/l
Stage II (proposed 2005)	40 ug/l	30 ug/l

For more information, please contact **MWRA Public Affairs at (617) 242-6000**
100 First Avenue, Charlestown Navy Yard, Boston, MA 02129.

For further information regarding health concerns, please contact the **Department of Public Health/Division of Epidemiology at (617) 983-6800** or **Boston Health and Hospitals at (617) 534-5611**.


Total Trihalomethane Results

Quarterly samples collected at seven community locations.

Results are in micrograms per liter.

South Lynnfield results show impact of local rechlorination on THMs.

Date	City Hall Arlington	City Hall Boston	Town Hall Norwood	Town Hall Quincy	City Hall Waltham	Town Hall Winthrop	Fire Sta. S. Lynnfield	Running Annual Average
March 1990	12.8	15	14	14.1	13.9	16.9	16.8	-
May 1990	-	8	10.7	10.1	10.5	11	32.1	-
August 1990	11	13	12	14	11	13	35	-
December 1990	14	10	13	13	14	-	28	14.3
January 1991	8.7	8.1	11.3	10.9	13.1	13.3	50.6	14.8
May 1991	13.8	10.9	12.9	12.9	13.9	15.2	43.5	15.7
July 1991	12	20	10	8.4	9	11	42	15.8
October 1991	13	7	16	15	14	20	32	16.7
February 1992	19.4	13.7	12.5	19	14.2	16.9	54.9	18.0
June 1992	15.4	18.8	18	19.3	19.7	21.7	48.3	19.3
September 1992	18	16	19	13	15	24	50	20.9
December 1992	17.6	11.8	14.3	13.3	12.4	14.2	26.3	20.6
March 1993	13.9	18.2	12.1	13.2	12.2	10	34.4	19.3
June 1993	13.3	15.6	14.3	15	15.3	21.1	37.2	18.2
August 1993	13.6	18.2	18	17.5	14.7	25.7	29.1	17.6
December 1993	12	12.5	12.6	11.7	11.8	16.2	25.9	17.3
January 1994	15	10.1	16.3	13.3	14	15.1	32.2	17.4
May 1994	14.2	12.5	16.4	18.1	16.8	17.3	34.9	17.3
September 1994	16.4	17.8	17.2	16.3	16.4	25.7	25	17.3
November 1994	14	13.2	21.4	28.4	14.7	14.5	27.8	18.4
January 1995	11.3	10.8	12.3	10.5	10.5	12.6	29.5	17.7
June 1995	16.3	14.8	17.9	16.4	18.7	18.2	36.7	18.0
September 1995	14.1	14.4	15.2	15.3	14.8	20	23.8	17.4
November 1995	10.8	12.1	11.3	10	10.4	11.7	25.2	15.9
February 1996	7.9	7.9	8.1	8.9	7.5	6.3	26.9	15.1
June 1996	12	19	19	19	12	19	36	15.0
September 1996	12	13	15	13	11	15	28	14.6
November 1996	8.5	13	11	10	8.3	10	39	14.9
February 1997	11	14	13	14	11	15	44	16.6
May 1997	17	18	18	20	15	18	36	16.8
Mean	13.0	13.6	14.4	14.5	13.2	15.6	34.4	17.1

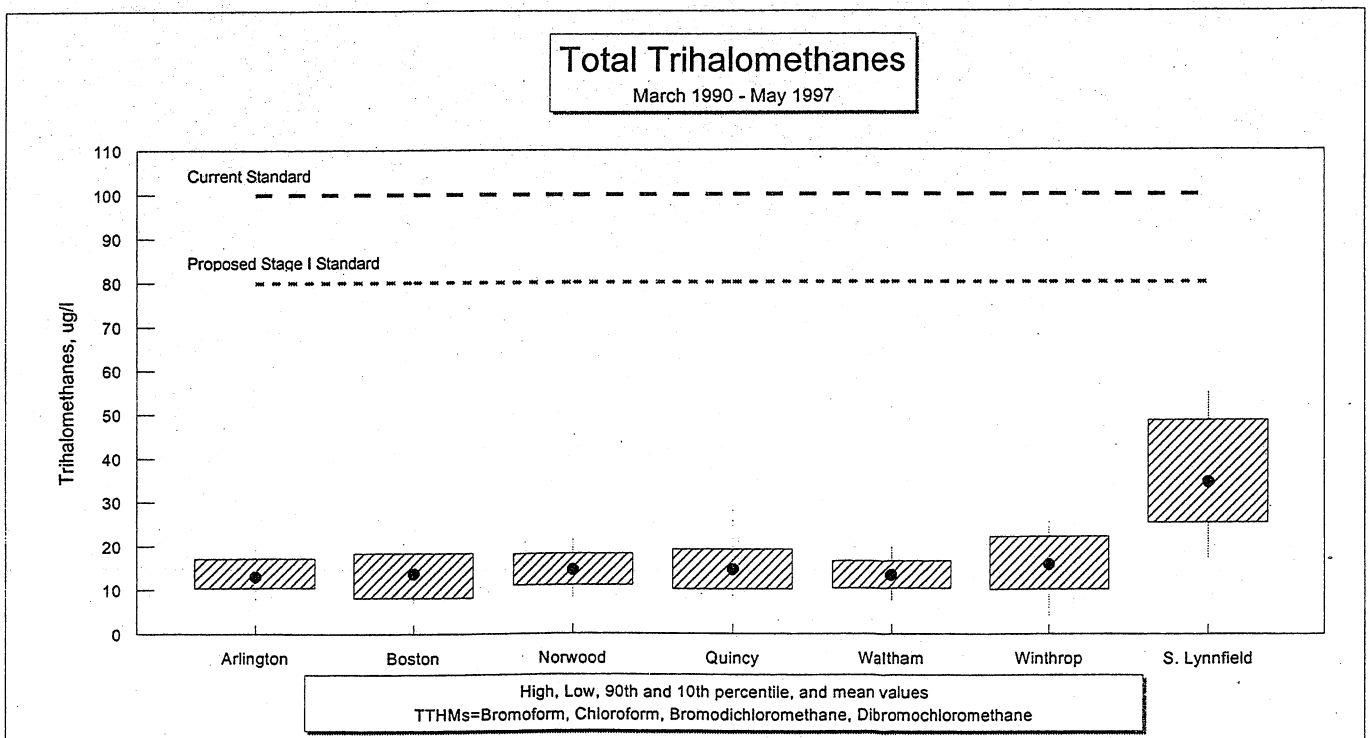

MWRA

**SOURCE WATER - CHICOPEE VALLEY AQUEDUCT
FECAL COLIFORM LEVELS AT QUABBIN (AS MEASURED AT WINSOR
POWER STATION) AND NASH HILL RESERVOIRS**

August 1997


Target

Quabbin Reservoir water is sampled at Winsor Power Station prior to chlorination and represents reservoir water entering the Chicopee Valley Aqueduct (CVA). Samples from Nash Hill Reservoir are collected at a point where CVA water enters the gatehouse. Depending on whether the reservoir is filling or discharging, this sample may or may not contain a mix of aqueduct water with reservoir water. If the reservoir is filling, the sample will contain a chlorine residual from chlorination that occurs at Winsor Power Station.

The SDWA standard is that no more than 20 fecal coliform/100ml be present in 10% of samples over a 6-month period.

Highlights

No fecal coliform were present in samples collected from Winsor Power Station. Fecal coliform levels remained well below the standard at Nash Hill Reservoir.

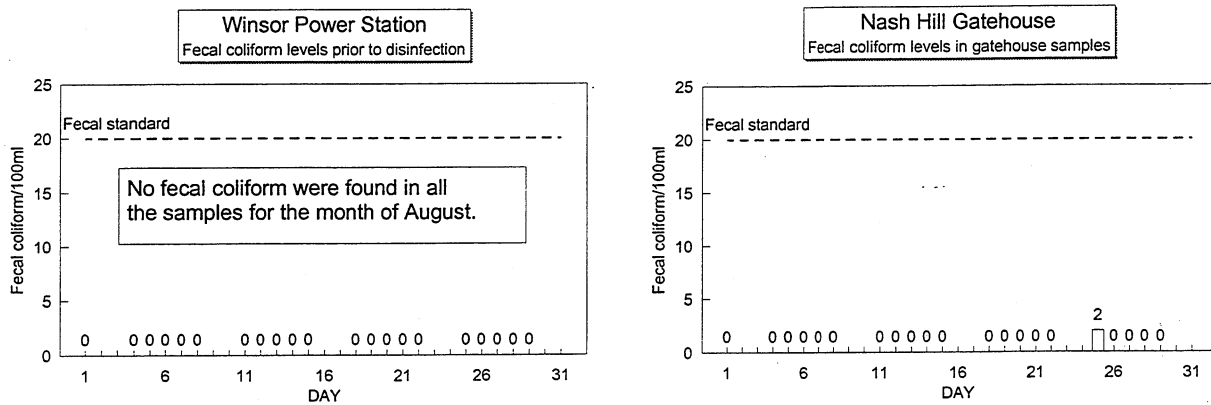

**SOURCE WATER - CHICOPEE VALLEY AQUEDUCT
TURBIDITY LEVELS AT QUABBIN RESERVOIR (AS MEASURED AT
WINSOR POWER STATION)**


August 1997

Target

Quabbin reservoir samples for turbidity are collected at Winsor Power Station prior to chlorination and represent reservoir water entering the CVA. The Massachusetts Department of Environmental Protection standard for source water turbidity is 1.0 NTU.

Highlights

Turbidity levels at Winsor Power Station have remained well below the DEP standard and averaged 0.33 NTU over the month.

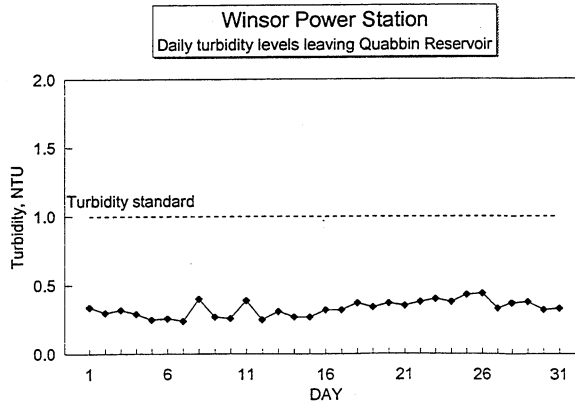

MWRA


SOURCE WATER FECAL COLIFORM LEVELS AT WACHUSETT RESERVOIR August 1997

Target

Samples from Wachusett Reservoir are collected at a location inside the Cosgrove Intake facility and represent water entering the Cosgrove Tunnel/Aqueduct. The Surface Water Treatment Rule (SWTR) standard of the SDWA for unfiltered surface supplies is that no more than 20 fecal coliform/100 ml be present in 10% of the samples over a 6-month period. The six month running average results present the percent of samples exceeding the standard during the previous 6 month period.

Highlights

Fecal coliform levels remained below the SDWA standards at Wachusett Reservoir.

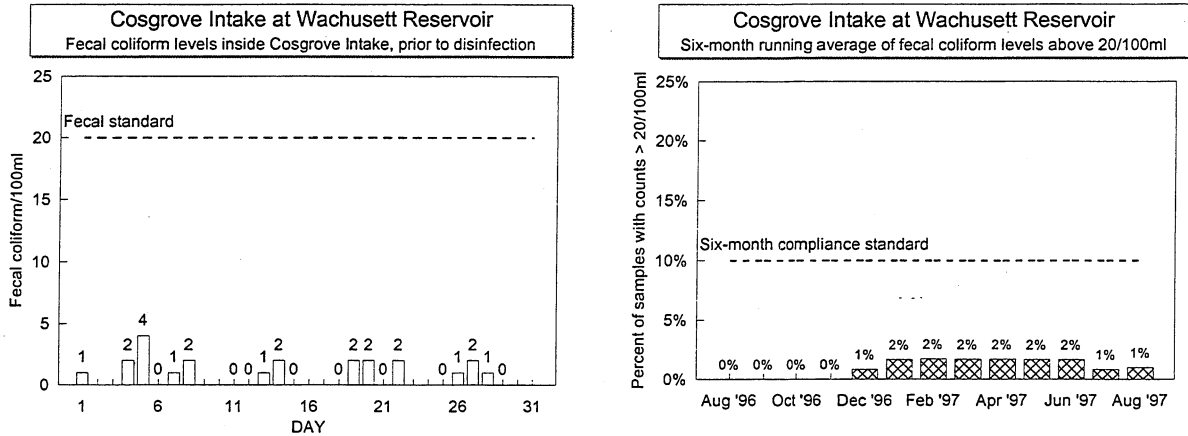

SOURCE WATER FECAL COLIFORMS IN NORUMBEGA RESERVOIR AND TURBIDITY LEVELS IN HULTMAN AQUEDUCT AT NORUMBEGA DISINFECTION FACILITY August 1997


Target

Fecal coliform samples from Norumbega Reservoir are collected from the shore near the gatehouse. Flow from Norumbega Reservoir supplements flows from Wachusett Reservoir during periods of high demand. The SDWA standard is that no more than 20 fecal coliform/100 ml be present in 10% of the samples over a 6-month period.

Samples for turbidity are measured after chlorination in the Hultman Aqueduct. The Massachusetts Department of Environmental Protection standard for source water turbidity is 1.0 NTU.

Highlights

The fecal coliform standard was exceeded in 1 of the 4 samples collected during the month from Norumbega Reservoir. Turbidity levels in the aqueduct have remained well below the DEP standard and averaged 0.34 NTU over the month.

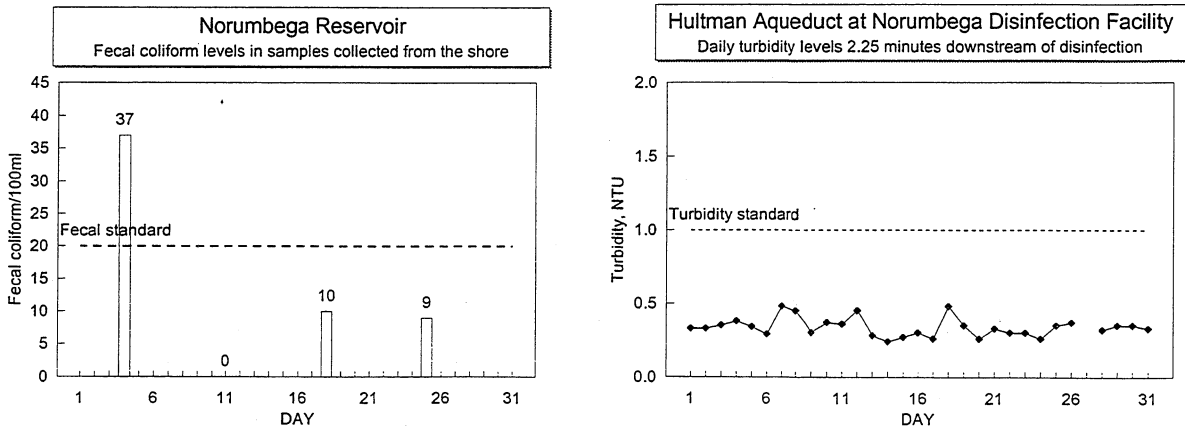

MWRA

TREATED WATER DISINFECTANT LEVELS IN HULTMAN AQUEDUCT AT NORUMBEGA DISINFECTION FACILITY AND COMMONWEALTH AVENUE PUMP STATION (ENTRY POINT INTO CUSTOMER DISTRIBUTION SYSTEMS)

August 1997

Target


Disinfection at Norumbega Disinfection Facility has been improved to allow 3-8 minutes of contact time with free chlorine before adding ammonia. The chlorine:ammonia-N ratio has also been changed to 5:1 resulting in a more stable and longer lasting chlorine residual. This change was implemented on August 11 to improve disinfection effectiveness. The disinfectant inactivates bacteria that may be present in the water as it leaves the Wachusett and Norumbega Reservoirs.

The target residual has been increased to 1.2 mg/l total chlorine two hours downstream of disinfection at Commonwealth Avenue Pumping Station in Newton, the first entry point into a customer distribution system.


Highlights

Total chlorine levels have averaged 1.61 mg/l 3-8 minutes downstream of disinfection. The disinfectant residual measured at Commonwealth Avenue Pumping Station, the entry point to customer distribution systems, has averaged 1.15 mg/l. The disinfection improvements have resulted in more stable residuals while using less chlorine.

Hultman Aqueduct at Norumbega Disinfection Facility
Disinfectant residual 3-8 minutes downstream of primary disinfection

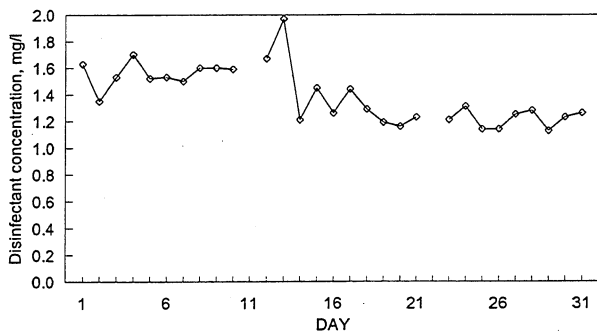

Commonwealth Avenue Pump Station
Disinfectant residual 2 hours downstream of primary disinfection

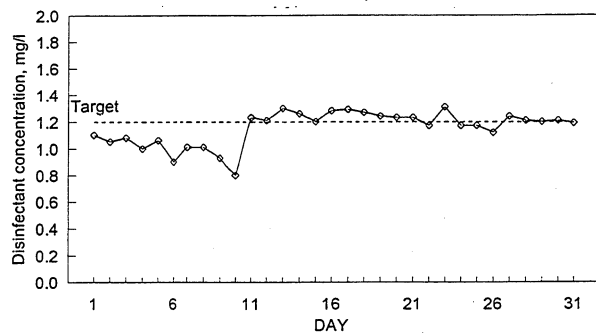

TREATED WATER pH LEVELS AT COMMONWEALTH AVENUE PUMP STATION

August 1997


Target

MWRA adjusts the alkalinity and pH of Wachusett water to reduce its corrosivity in order to minimize the leaching of lead and copper from service lines and home plumbing systems into the water. In June 1996, the Interim Corrosion Control (ICC) facility went on-line and is providing corrosion control to communities east of and including Marlborough. The target pH is 7.8 (target range between 7 and 8 pH units).

Highlights

During the month, pH values ranged between 7.5 and 8.8. The average pH was 8.1.

Commonwealth Avenue Pump Station pH
High, Low, 90th and 10th Percentile pH Values

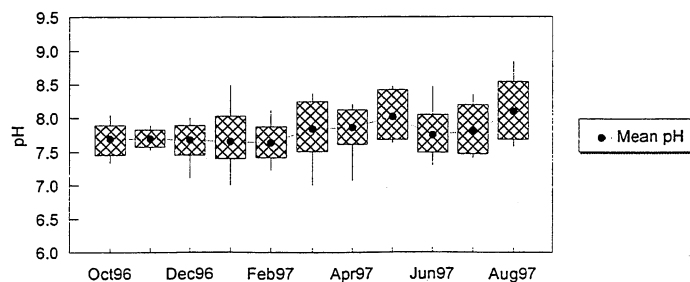

MWRA
WATER QUALITY UPDATE FOR COMMUNITIES PARTICIPATING
IN MWRA TESTING PROGRAM
 August 1997

Target

Thirty-two cities and towns use the MWRA Laboratory for Total Coliform Rule compliance testing. The communities collect samples for bacteriological analysis and measure chlorine residual at the time of collection. The other 14 MWRA customer communities have their samples tested elsewhere and these towns should be contacted directly for their results.

The SDWA requires that no more than 5% of all samples may be total coliform positive in a month (or no more than 1 positive when less than 40 samples are collected each month). Public notification is required if this standard is exceeded.

If E. coli are detected in a drinking water sample, this is considered evidence of a critical public health concern. Additional testing is conducted immediately and joint corrective action by DEP, MWRA, and the community are undertaken. Public notification is required if follow-up tests confirm the presence of E. coli or total coliform.

A disinfectant residual of 0.2 mg/l is considered a minimum target level at all points in the distribution system.

Highlights

During the month of August, twenty-seven communities submitted samples with no coliform bacteria. Five communities had positive total coliform results. No E. coli positive samples were identified any samples collected. In Saugus and Stoneham, the SDWA standard of no more than 5% positive samples was exceeded and public notification was required.

Eighteen of the twenty-five communities submitting chlorine residual data maintained an average disinfectant residual of at least 0.2 mg/l. Twenty-two communities had 1 or more samples with a disinfectant residual of less than 0.2 mg/l.

TOWN	Samples Tested for Coliform (a)	Total Coliform % Positive	E. coli % Positive	Public Notification Required?	Average Chlorine Residual, mg/l	Minimum Chlorine Residual, mg/l
ARLINGTON	56				0.15	0.00
BELMONT	32				0.35	0.10
BOSTON	227	0.4		No (c)	0.55	0.05
BROOKLINE	68				0.51	0.05
CHELSEA	32				0.17	0.10
EVERETT	40				0.36	0.10
FRAMINGHAM (b)	90	1.1		No (c)		
LEXINGTON	36				0.34	0.10
LYNNFIELD (b)	14				0.45	0.10
MALDEN	60				0.21	0.00
MARBLEHEAD (b)	24				0.47	0.04
MEDFORD	68				0.21	0.00
MELROSE	36				0.18	0.05
MILTON	32				0.31	0.20
NAHANT (b)	10				0.28	0.05
NEEDHAM (b)	42					
NEWTON	87				0.43	0.06
NORWOOD	40				0.20	0.20
QUINCY	92				0.33	0.05
REVERE	52				0.15	0.10
SAUGUS	243	23.0		Yes (d)	0.25	0.10
SOMERVILLE	80				0.13	0.10
SOUTHBOROUGH (b)	7					
STONEHAM	104	63.5		Yes (d)	0.17	0.05
SWAMPSCOTT (b)	18					
WAKEFIELD (b)	44					
WALTHAM	66				0.53	0.30
WATERTOWN	40				0.23	0.10
WELLESEY (b)	39	2.6		No (c)		
WESTON (b)	12					
WINCHESTER (b)	20				0.40	0.13
WINTHROP	24				0.17	0.05
TOTAL	1835					

- (a) The number of samples collected is dependent on the population served and the number of repeat samples required.
 (b) These communities provide chlorination.
 (c) Less than 5% total coliform positive, therefore public notification not required.
 (d) 5% total coliform standard exceeded. Public notification required.

MWRA



SOURCE WATER
FECAL COLIFORM LEVELS AT SPOT POND AND FELLS RESERVOIR
 August 1997

Target

Samples from Spot Pond are collected inside the East Gatehouse prior to disinfection. Disinfected water from Spot Pond supplies the Fells Reservoir and Bear Hill Standpipe service areas. Fells Reservoir samples are collected from the shore at a point near the gatehouse. If Fells Reservoir is filling, samples may contain a chlorine residual from the chlorination that occurs at Spot Pond. The SDWA standard is that no more than 20 fecal coliform/100 ml be present in 10% of samples over a 6-month period.

Highlights

Fecal coliform levels have remained below the SDWA standard at Spot Pond and Fells Reservoir throughout the month.

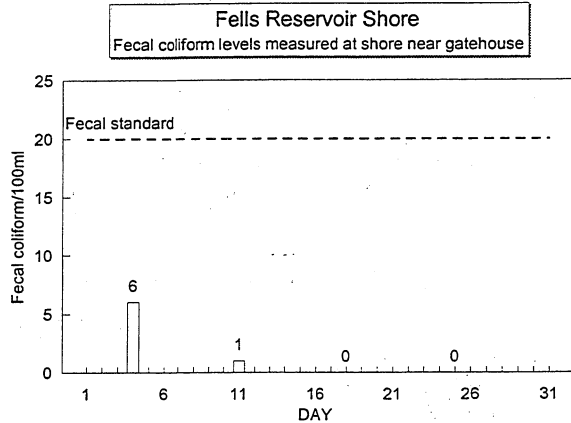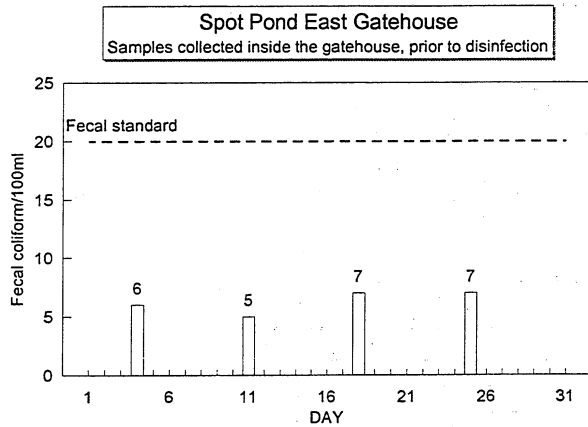



SOURCE WATER
TURBIDITY LEVELS AT SPOT POND AND FELLS RESERVOIR
 August 1997

Target

Turbidity values are highly variable at Spot Pond and Fells Reservoir due to variability in water flow. Spot Pond samples are collected at a point after chlorination and represent water leaving the pump station. Fells Reservoir samples are collected in the gatehouse. The Massachusetts Department of Environmental Protection standard for source water turbidity is 1.0 NTU.

Highlights

Turbidity levels at Spot Pond and Fells were highly variable during the month and exceeded 1.0 NTU on several occasions. The DEP standard requires that the average for the month not exceed 1.0. This standard was not exceeded at either location. Spot Pond turbidity averaged 0.88 NTU and Fells Reservoir averaged 0.95 NTU over the month.

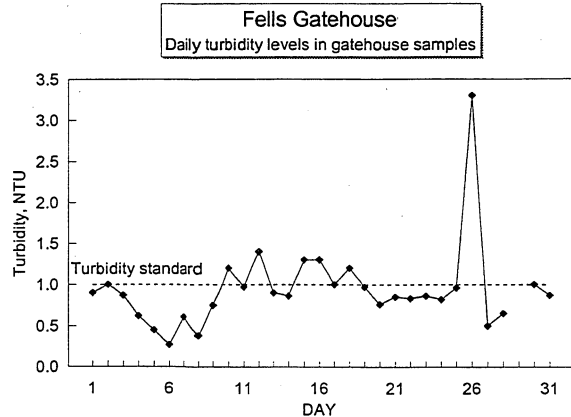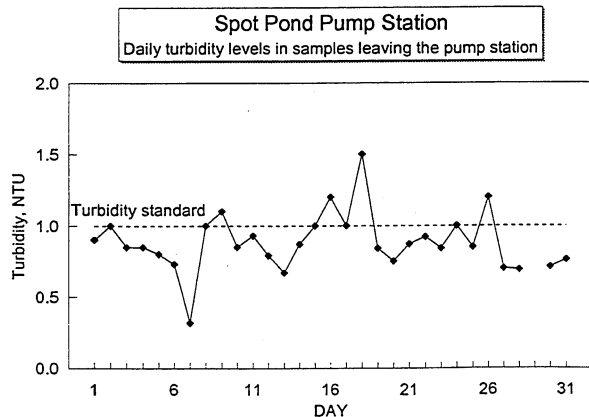

MWRA



TREATED WATER DISINFECTANT LEVELS AT SPOT POND AND FELLS RESERVOIR August 1997

Target

Target disinfectant dosage levels at Spot Pond and Fells Reservoir are normally 1.0 mg/l of free chlorine although higher levels may be desired depending upon water temperature, presence of fecal coliform, or changing local conditions. Target levels are difficult to maintain due to the type of chlorine feed equipment used and the highly variable flow at these locations. Residuals are measured at a point immediately after disinfection.

Highlights

Disinfectant residual levels at Spot Pond and Fells Reservoir were highly variable throughout the month due to difficulty in obtaining representative samples at these locations. A target of 1.0 mg/l total chlorine leaving these locations is desired at all times. On August 10, the residual of 3.5 mg/l was probably due to stagnant water in the residual analyzer.

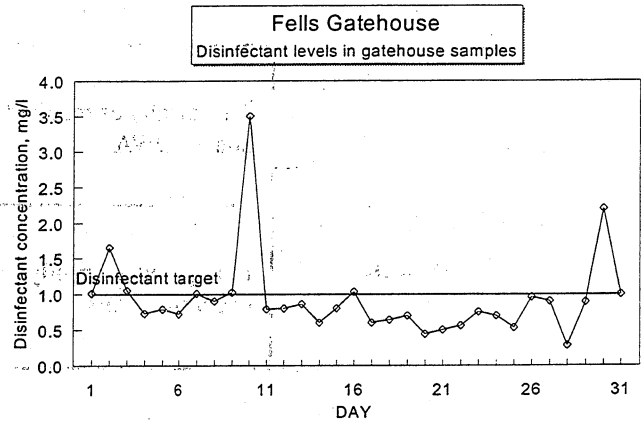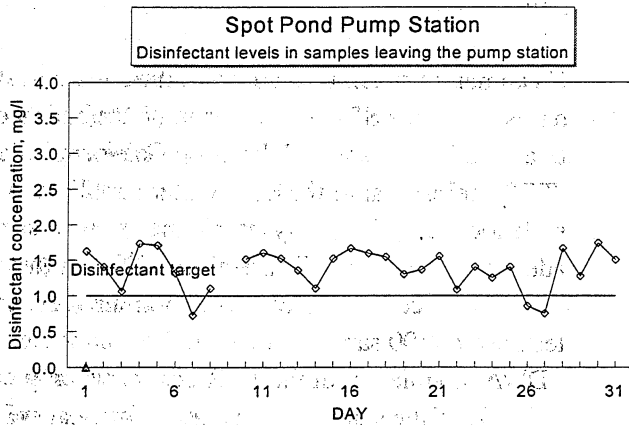



TREATED WATER pH LEVELS AT SPOT POND AND FELLS RESERVOIR August 1997

Target

The pH of Spot Pond water is monitored and adjusted to reduce corrosivity in order to minimize the leaching of lead and copper from service lines and home plumbing systems into the water. The target pH is between 7 and 8 pH units.

Highlights

pH levels are variable at these locations. During the month of August, eighty percent of samples ranged between 7.1 and 7.6 pH units at Spot Pond Reservoir, and between 6.9 and 7.7 at Fells Reservoir. The average pH at Spot Pond was 7.4 and for Fells was 7.2 pH units.

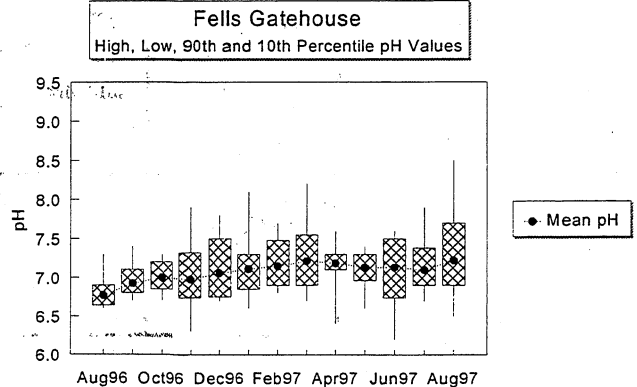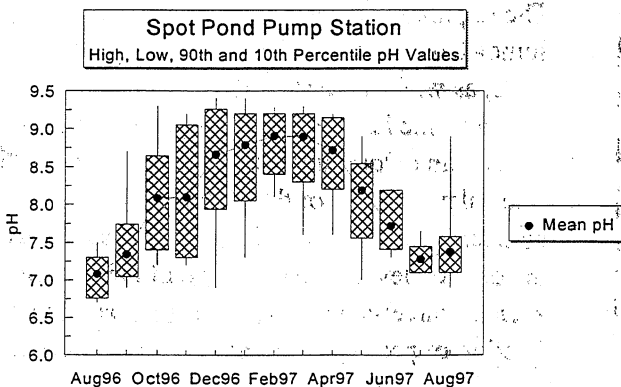

FREQUENCY OF SOURCE WATER QUALITY SAMPLING PROGRAM

PARAMETER	MWRA SAMPLES
Total and Fecal coliform	daily at source reservoirs, weekly in distribution reservoirs
Turbidity	daily at source and distribution reservoirs
pH	daily at distribution reservoirs
Chemical analyses	periodically as required under SDWA
Radionuclides	as required, currently every five years

FREQUENCY OF TREATED WATER QUALITY SAMPLING PROGRAM

PARAMETER	MWRA SAMPLES	COMMUNITY SAMPLES
Total coliform	weekly at select locations	frequency and number depends on population served
Disinfectant Residual	weekly at select locations	collected with total coliform samples
pH	weekly at select locations	

FEDERAL SAFE DRINKING WATER ACT (SDWA)

The Surface Water Treatment Rule (SWTR) of the SDWA sets standards for unfiltered use of MWRA's source waters from the Quabbin and Wachusett Reservoirs. If such standards are not met, filtration could be required. The standards relate to coliform, turbidity, color, watershed protection, disinfection and monitoring, and the absence of waterborne disease outbreaks. Quabbin Reservoir has demonstrated compliance with the standards and has therefore been found to be exempt from the filtration requirement. A decision about filtration of Wachusett source water has been deferred until 1998 as part of the consideration of treatment process technology at the new MWRA treatment plant to be constructed at Walnut Hill.

Customer communities must also meet certain standards under the SDWA concerning distribution of treated drinking water. The Total Coliform Rule (TCR) helps to alert the local water suppliers to possible local distribution system issues as well as the adequacy of residual disinfection. MWRA provides testing services for many of the communities, and tests over 1500 samples per month. Under the SDWA, a violation of the TCR occurs when greater than 5% of the samples are positive for total coliform.

DISINFECTANT RESIDUAL

The effectiveness of disinfection is calculated by determining the length of time water is in contact with a specific dosage of disinfectant. This calculated value is commonly called CT (Concentration multiplied by Time) and is derived mathematically from assumptions about the residual disinfectant dosage in the water as it reaches the user multiplied by the travel time from the point of application of the disinfectant.

The required CT to provide target inactivation varies somewhat due to ambient pH or temperature conditions, as well as the strength of the disinfectant, *e.g.* free chlorine has greater pathogen inactivation properties than chloramines in the same concentration. The calculated CT of the disinfection system is then compared to the required values necessary to achieve the desired level of inactivation of key pathogens such as bacteria, viruses, and protozoa. In this classification of pathogens, bacteria are the most prevalent

and are the first focus of disinfection. Fortunately, harmful bacteria are relatively easily inactivated by chlorination. Viruses are more resistant to chlorination. *Giardia* and *cryptosporidium* are examples of pathogenic protozoa that are particularly difficult to inactivate using normal dosages of chlorine but are less commonly found in source waters.

The reduction of residual disinfectant levels within a pipeline system is affected by a variety of factors including temperature, presence of organic matter in

the water or on the pipe surface and corrosion of the pipe surface. For residual disinfection, MWRA uses a chlorine-ammonia combination to form chloramines, a longer-lasting residual disinfectant than free chlorine alone. The level of the residual disinfectant is measured throughout the distribution system using a colorimetric test by which a color change in the sample is compared to a color chart in order to estimate the disinfectant concentration within a reasonable degree of accuracy.

GLOSSARY

CHLORINATION: Disinfection by adding chlorine.

CHLORAMINATION: Disinfection by adding a mixture of chlorine and ammonia.

COLIFORM BACTERIA: Group of bacteria that indicate the possibility of contamination in a water supply. A subclass of the coliform group, fecal coliform bacteria, indicate possible contamination from intestinal sources.

CORROSION CONTROL FACILITY: Water quality facility that helps to stabilize both the water's pH and alkalinity by adding soda ash and carbon dioxide.

CRYPTOSPORIDIUM: Microscopic protozoa which, when ingested, can result in diarrhea and other flu-like symptoms.

ESCHERICHIA COLI (E. COLI): A bacterium that is a primary indicator of fecal contamination in a water supply. *E. coli* is a member of the coliform group of bacteria.

GIARDIA LAMBLIA: Microscopic protozoa which, when ingested, can result in diarrhea and other flu-like symptoms.

NTU: Nephelometric turbidity unit. A standard measure of turbidity in a water sample.

PATHOGENS: Disease-causing organisms.

RESERVOIR: A natural or man-made basin where water is collected and stored in large quantities before being supplied to a community.


SAFE DRINKING WATER ACT (SDWA): Federal drinking water quality regulations.

TOTAL COLIFORM RULE (TCR): SDWA standard that limits the level of total coliform positive results allowed each month in a community.

TURBIDITY: Measure of the particulate matter in a water sample.

MWRA WATER SUPPLY AND TREATMENT

To view the level of treatment your water has received, locate your community on the chart.

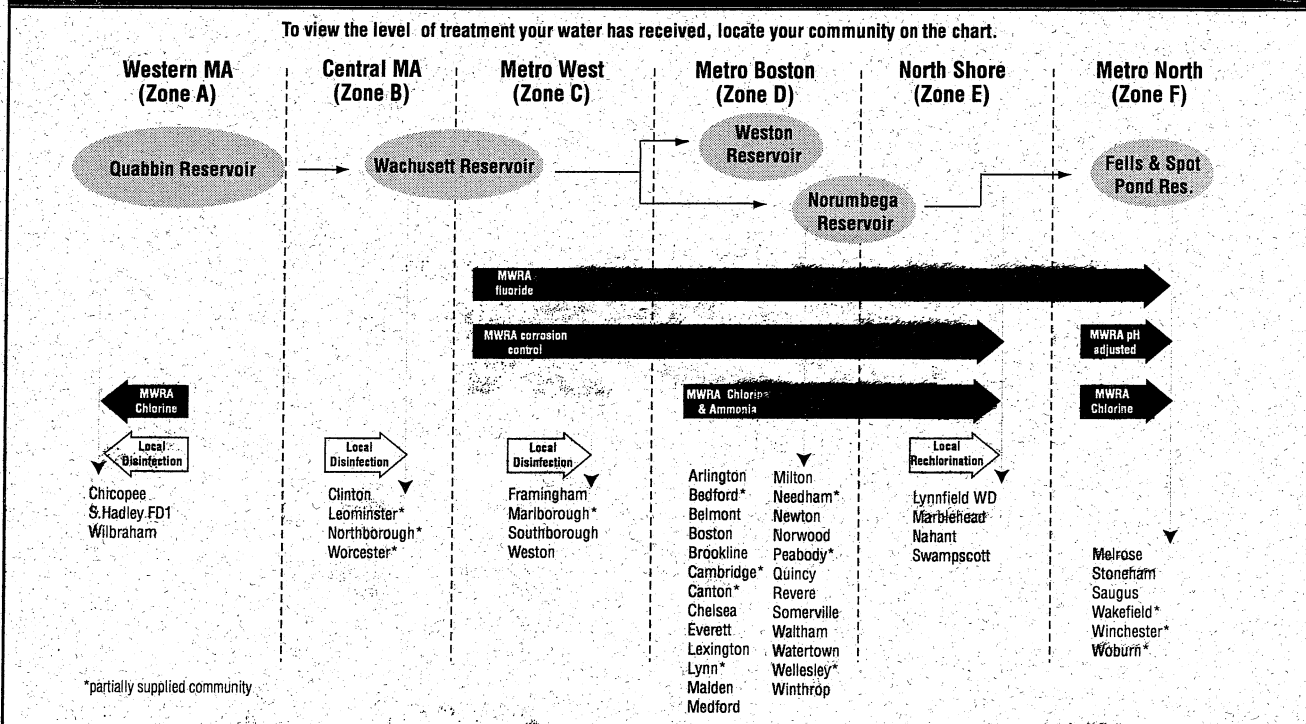

Prepared under the direction of:
Douglas B. MacDonald, Executive Director
William A. Brutsch, Waterworks Director
D. Kelly O'Day, Operations Director, Waterworks