

For more information, please contact MWRA at (617) 242-5323, or visit www.mwra.com.

WATER QUALITY UPDATE An Analysis of October 2004 Sampling Data

MASSACHUSETTS WATER RESOURCES AUTHORITY
100 First Avenue, Charlestown Navy Yard, Boston, MA 02129



MWRA WATER QUALITY UPDATE

October 2004 Highlights

•**MWRA achieved CT disinfection requirements for the month** at the Ware Disinfection Facility (WDF) and the Cosgrove Disinfection Facility (CDF). CT results appear on Page 5. The running annual averages for DBPs are higher this year as compared to last year, but still within standards. See page 7. One community had samples which violated the Total Coliform Rule criteria. See Page 6.

•**The Interim Corrosion Control Facility (ICCF) was shutdown on October 26** in order to allow the transition of flow from the Cosgrove Tunnel to the Wachusett Aqueduct. The Cosgrove Tunnel was shutdown on the 25th at 9:30 pm through the 26th until 6:00 pm and the Wachusett Aqueduct was activated on the 26th from 1:00 am to 4:30 pm. This transition was necessary to allow for the inspection and repair of a leak which was found at Shaft C piping to the Walnut Hill Water Treatment Plant on the 13th. The ICCF was shutdown for six hours on this date to locate the leak. For repairs to be made, the Cosgrove Tunnel was shutdown on November 12th and the Wachusett Aqueduct was reactivated.

•**Short Duration Fluoride Spike** - When the ICCF was shut down and restarted on October 26th, fluoride accumulated in the chemical feed lines, causing 2 slugs of water which contained elevated levels of fluoride. Each event was of short duration, each lasting no longer than half hour. Maximum fluoride levels detected in the system were 8.4 mg/L. While this short duration spike exceeds the MCL value of 4 mg/L, compliance with the MCL is based on a running annual average and this level will not be exceeded over the year. MWRA is revising startup and shut down standard operating procedures and notification policies to prevent a future recurrence.

Let us know what you think [\(617\) 242-5323](tel:6172425323)

Release Date: November 20, 2004

Water Quality Update


This is a monthly report containing information about the quality of water supplied by MWRA. It provides a more detailed review of water quality than the annual water quality report that is mailed each June to customers in our service area. The report is available at www.mwra.com.

The Water System

MWRA provides about 250 million gallons of water each day to 46 cities and towns in Massachusetts. Each municipality is responsible for distributing the water within its own community. More than two million people are served by the MWRA water supply system.

Quabbin Reservoir is the primary source of water for our system and one of the country's largest water supply impoundments, with a capacity of 412 billion gallons. Quabbin water represents source water for the Chicopee Valley Aqueduct (CVA) system. Water is transferred from Quabbin Reservoir to the 65 billion gallon Wachusett Reservoir in Clinton via the Quabbin Aqueduct. Wachusett water represents source water for MetroWest and Metropolitan Boston communities. The watershed areas of the Quabbin and Wachusett Reservoirs total 401 square miles. The Department of Conservation and Recreation (DCR), which manages the watersheds, and MWRA are committed to protection of the water supply through aggressive watershed protection as the first line of defense against water contamination. Three-quarters of the watersheds are protected lands and over 80% are either forest or wetlands.

The map below indicates the location of reservoirs, treatment facilities, and service communities.

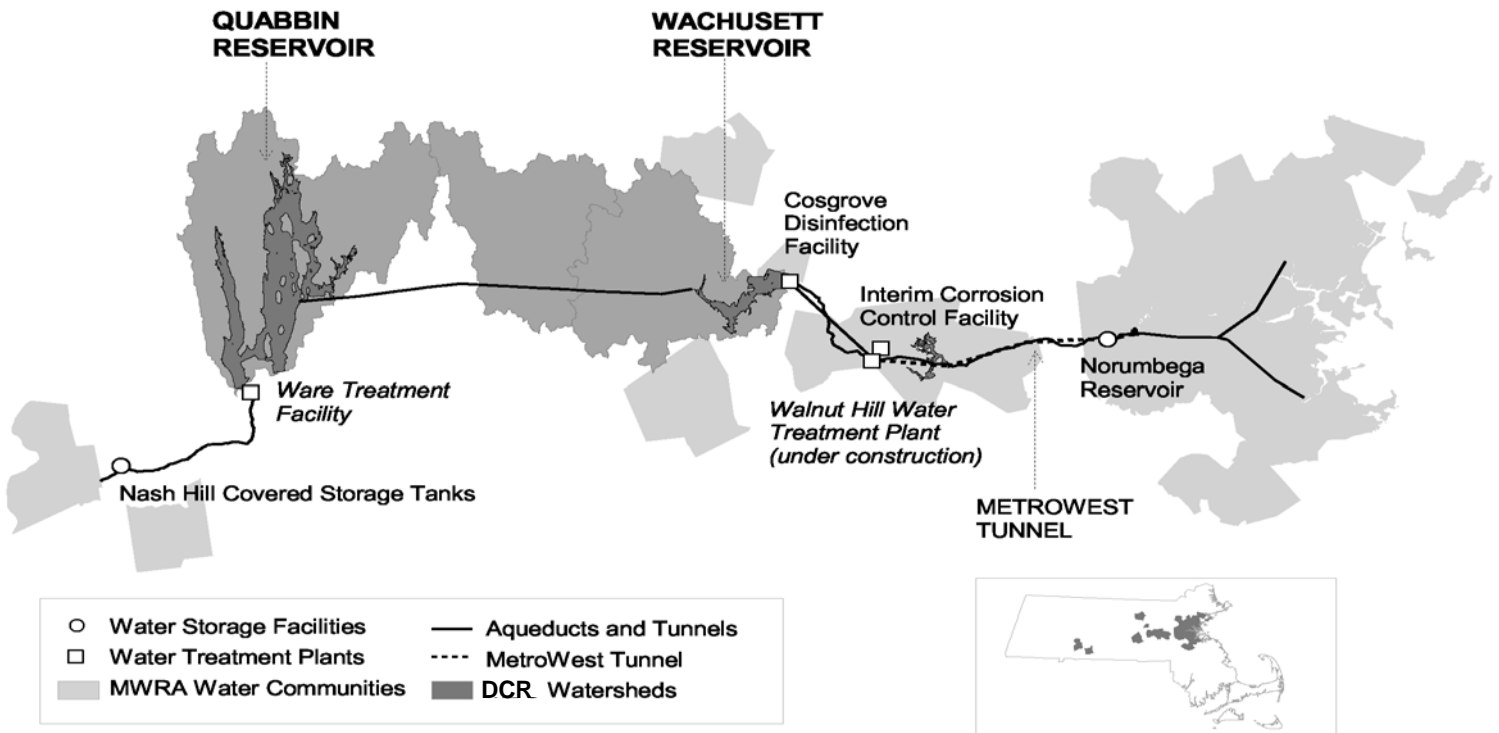

Indicators of Water Quality

Tests are conducted on water sampled at the source reservoirs (source or raw water) and also on water after treatment (treated water). MWRA routinely uses six general indicators of water quality: microbial, corrosiveness, disinfection by-products, turbidity and algae, disinfectant residual, and mineral analysis. Testing frequencies vary by parameter.

The Federal Safe Drinking Water Act (SDWA) sets standards for source and treated water quality. The standards relate to coliform, turbidity, watershed protection, disinfection and disinfection by-products, over 120 potential chemical contaminants, and waterborne disease outbreaks. MWRA monitors for these parameters on schedules ranging from daily to annually.

Customer communities must also meet certain standards under the SDWA concerning distribution of treated drinking water. The Total Coliform Rule (TCR) helps to alert communities to possible microbial contamination as well as the adequacy of residual disinfection within the local distribution system. MWRA tests over 1500 samples per month. Under the SDWA, a violation of the TCR occurs when greater than 5% of the samples in a community are positive for total coliform during a month.

Source Water – Microbial Results

October 2004

Source Water - Microbial Results

Total coliform bacteria are monitored in both source and treated water to provide an indication of overall bacteriological activity. Most coliforms are harmless. Fecal coliform, a subclass of the coliform group, which are identified by their growth at temperatures comparable to those in the intestinal tract of mammals. They act as indicators of possible fecal contamination. The Surface Water Treatment Rule for unfiltered supplies requires that no more than 10% of source water samples prior to disinfection over any six-month period have more than 20 fecal coliforms per 100ml.

Sample Site: Quabbin Reservoir

Quabbin Reservoir water is sampled at the Ware Disinfection Facility (WDF) raw water tap before entering the CVA system as of July 13, 2004. Prior data was sampled at Winsor Dam. MWRA met the six-month running average standard for fecal coliform continuously at this location over the last year.

Fourteen of the 31 samples were positive during October. None of the samples exceeded the 20 cfu/100ml count. All of the colony counts were in the single digits.

For the current six-month period, 0.5% of the samples have exceeded a count of 20 cfu/100ml.

Sample Site: Wachusett Reservoir

Wachusett Reservoir water is sampled before it enters the MetroWest and Metropolitan Boston systems at the Cosgrove Intake. On October 26, the sample was collected at the Wachusett Intake which was activated that day.





Fecal coliform levels tend to increase during the winter because, when water bodies near Wachusett ice over, waterfowl seek open water. Many roost at Wachusett, which tends to freeze later in the year than smaller ponds nearby.

Twenty-two of the 23 samples were positive during October at the Cosgrove Intake. The Wachusett Intake sample was negative. None of the samples exceeded the 20 cfu/100ml count. All of the colony counts were in the single digits.

For the current six-month period, 0.8% of the samples have exceeded a count of 20 cfu/100ml (One of the samples exceeded 20 cfu/100ml).

UV

UV-254 is a surrogate measure of reactive organic matter and is a good predictor for DBP levels. Levels are around 0.047 A/cm.

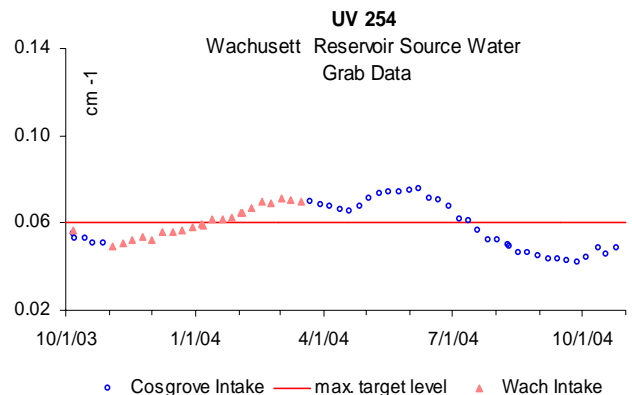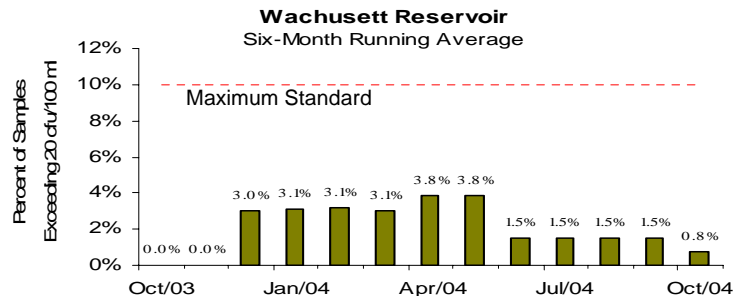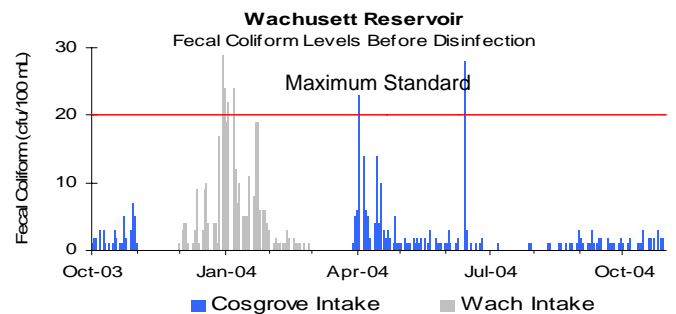
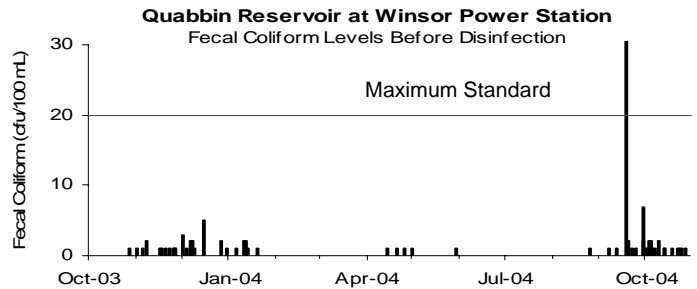


Source Water – Turbidity and Algae Results October 2004

Source Water – Turbidity Results

Turbidity is a measure of suspended and colloidal particles including clay, silt, organic and inorganic matter, algae and microorganisms. The effects of turbidity depend on the nature of the matter that causes the turbidity. High levels of particulate matter may have a higher chlorine demand or may protect bacteria from the disinfectant effects of chlorine, thereby interfering with the disinfectant residual throughout the distribution system.



Samples for turbidity from Quabbin Reservoir are collected at the Ware Disinfection Facility before chlorination. Samples from Wachusett Reservoir were taken at Wachusett Intake before chlorination from November 1, 2003 to March 16, 2004 and again on October 26, 2004 from 1a to 4:30 pm; samples before and after this period are taken at the Cosgrove Intake. The Massachusetts Department of Environmental Protection standard for source water turbidity for unfiltered water supply systems is a maximum of 1.0 NTU; the EPA standard is a maximum of 5.0 NTU. Maximum turbidity results at Quabbin and Wachusett were within DEP standards for the month.

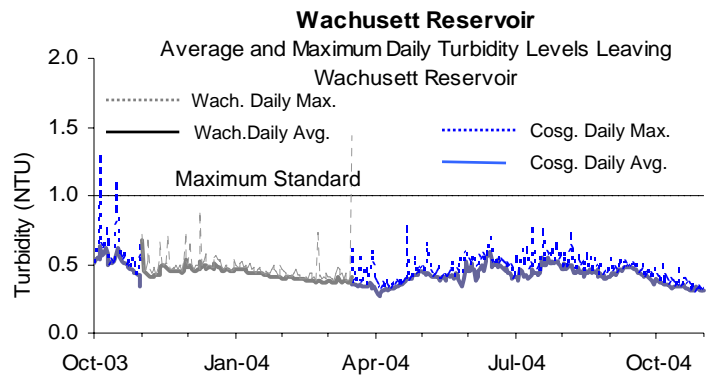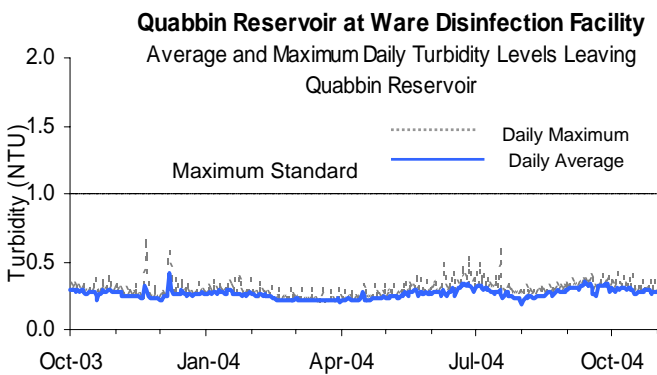

Source Water – Algae Results

Algal levels in reservoirs are monitored by DCR and MWRA. These results, along with taste and odor complaints, are used to make decisions on source water treatment for algae control. Most taste and odor complaints at the tap are due to algae, which originate in source reservoirs, typically in trace amounts. Occasionally, a particular species grows rapidly, increasing its concentration in water. When *Synura*, *Anabaena*, or other nuisance algae blooms, MWRA may treat the reservoirs with copper sulfate, an algacide.

Of the 23 complaints received during October from local water departments, six concerned taste and odor that may be due to algae. No algal blooms of note occurred.

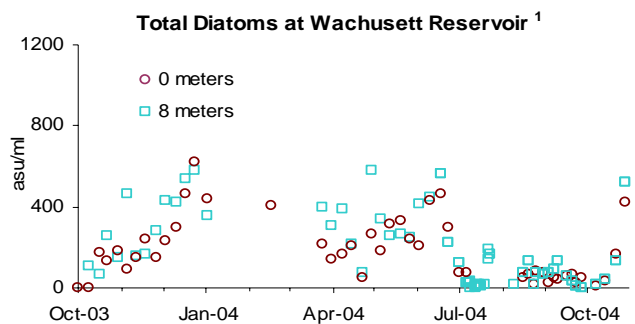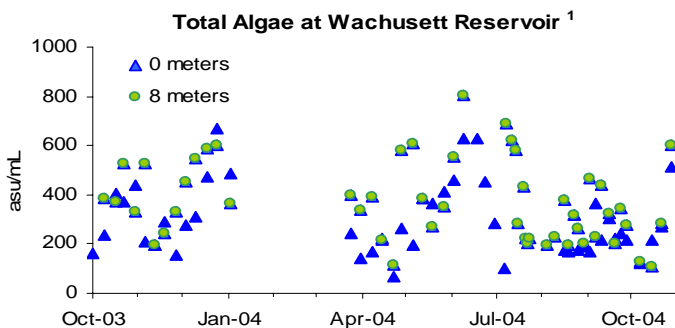

1. Algae samples collected between 0 to 3 meters represent the same area of water column and are generally equivalent. These samples will be shown in the graphs as 0 meters.

Treated Water – Disinfection and pH Results

October 2004



Treated Water - Primary Disinfection

MWRA provides disinfection adequate to achieve EPA's requirement of 99.9% inactivation of *Giardia* cysts and 99.99% inactivation of viruses in drinking water using a calculation based on three sample points that DEP approved in June, 1999. The one-point, two-point timeslice, three-point timeslice, or integrated methods are alternative calculation methods which can also be used to comply with CT regulations.

CT achievement for *Giardia* assures CT achievement for viruses, which have a lower CT requirement. The concentration (C) of the disinfectant in the water over time (T) yields a measure of the effectiveness of disinfection, CT. The required CT varies with disinfectant type, water temperature, pH, and other factors. MWRA calculates daily CT inactivation rates at maximum flow, as specified by EPA regulations.



Wachusett Reservoir - MetroBoston Supply:

Chlorine dose at the Cosgrove Disinfection Facility (CDF) varied between 1.3 and 2.0 mg/L. The Wachusett Temporary Disinfection Facility (WTDF) was activated on the October 26 for approximately 16 hours. The one-point timeslice method was used to determine CT. CT was met each day in October, as well as every day for the last year.

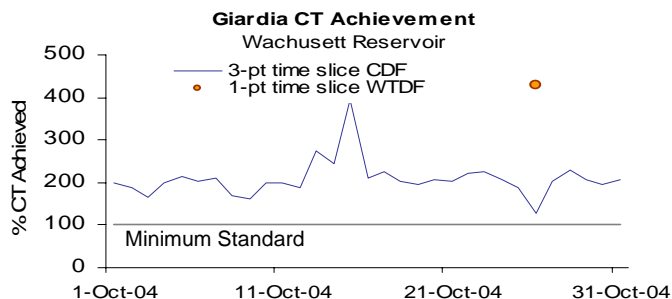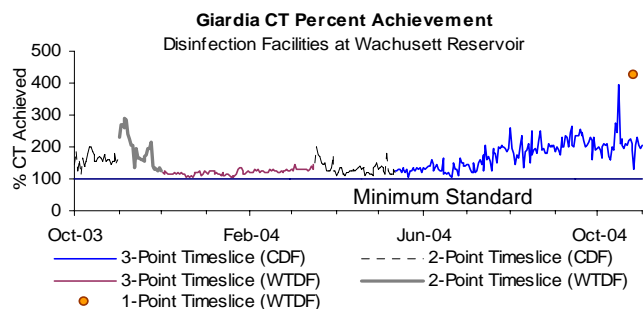



Quabbin Reservoir at Ware Disinfection Facility (CVA Supply):

Chlorine dose remained at 1.3 mg/L. CT was met each day in October, as well as every day for the last year.

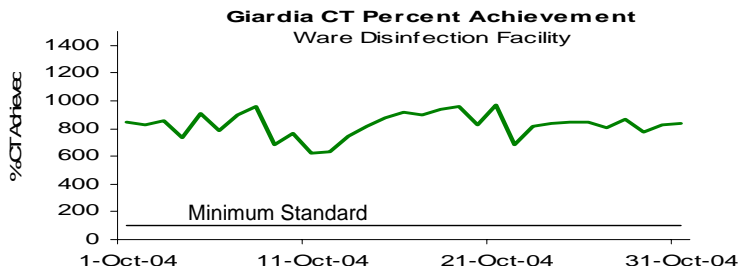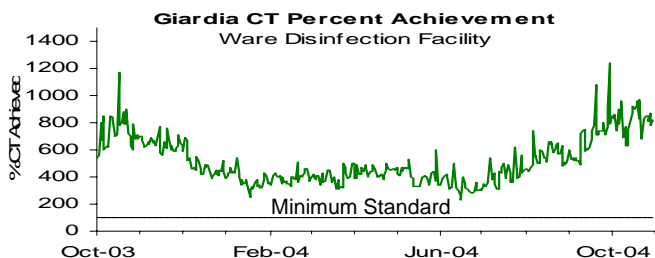

Treated Water – pH and Alkalinity Results

MWRA adjusts the alkalinity and pH of Wachusett water to reduce its corrosivity in order to minimize the leaching of lead and copper from service lines and home plumbing systems into the water. MWRA's target for distribution system pH is 9.1 and alkalinity is 40 mg/l. On October 27th, the alkalinity dropped to 13.9 mg/L in the distribution system. This was the effect from the high dosing of fluoride at the Interim Corrosion Control Facility. MWRA's goal is to have 80% of distribution system pH samples fall between 8.8 and 9.4. MWRA staff collects and analyzes samples for pH from 28 community locations on a biweekly schedule to measure pH levels. In October, 100% of the samples were within the target range. On October 27th, the alkalinity dropped to 13.9 mg/L in the distribution system. This was the effect from the temporary shutdown of the Interim Corrosion Control Facility.

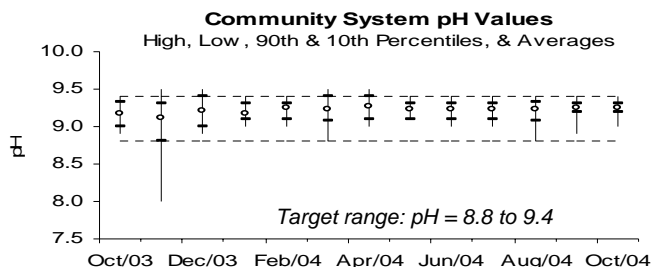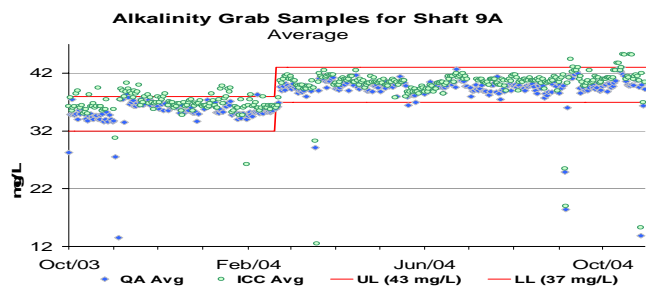

Bacteria & Chlorine Residual Results for Communities in MWRA Testing Program

October 2004

Background

Background

While all communities collect bacteria samples for the Total Coliform Rule (TCR), 37 cities and towns (including Deer Island and Westboro State Hospital) use the MWRA's Laboratory for TCR compliance testing. These communities collect samples for bacteriological analysis and measure water temperature and chlorine residual at the time of collection. The other 9 MWRA customer communities (including Lynn's GE plant) have their samples tested elsewhere and these towns should be contacted directly for their monthly results.

There are 144 sampling locations for which the MWRA is required to report TCR results. This includes a subset of the community TCR locations, as well as sites along the MWRA transmission system, water storage tanks and pumping stations.

The Safe Drinking Water Act (SDWA) requires that no more than 5% of all samples may be total coliform positive in a month (or that no more than 1 sample be positive when less than 40 samples are collected each month). Public notification is required if this standard is exceeded.

Escherichia coli (E.coli) is a specific coliform species that is almost always present in fecal material and whose presence indicates likely bacterial contamination of fecal origin. If *E. coli* are detected in a drinking water sample, this is considered evidence of a critical public health concern. Additional testing is conducted immediately and joint corrective action by DEP, MWRA, and the community is undertaken. Public notification is required if follow-up tests confirm the presence of *E. coli* or total coliform. MWRA considers a disinfectant residual of 0.2 mg/L a minimum target level at all points in the distribution system.

Highlights

Four of the 1,677 community samples (0.24%) system-wide tested positive for confirmed total coliform during the month of October. None of the 616 MWRA samples (0.00%) tested positive for confirmed total coliform. No samples tested positive for *E. coli*. One town, Southborough, failed the TCR rule for the month. Follow up samples were taken up and down stream of the positives and did not confirm for total coliform. Westborough SH did not violate the TCR since only one sample was positive in their system which collects fewer than 40 samples/ month.

All thirty-seven communities that submitted chlorine residual data maintained an average disinfectant residual of at least 0.2 mg/L. 2.7% of the community samples had a disinfectant residual lower than 0.2 mg/L.

TCR results by Community

Town	Samples Tested for Coliform (a)	Total Coliform # (%) Positive	E.coli % Positive	Public Notification Required?	October 2004 Minimum Chlorine Residual (mg/L)	October 2003 Minimum Chlorine Residual (mg/L)	October 2004 Average Chlorine Residual (mg/L)	October 2003 Average Chlorine Residual (mg/L)
ARLINGTON	54	0 (0%)			0.05	0.04	0.98	0.65
BELMONT	32	0 (0%)			0.14	0.05	1.15	0.73
BOSTON	224	0 (0%)			0.63	0.26	1.49	1.16
BROOKLINE	68	0 (0%)			0.91	0.72	1.68	1.26
CHELSEA	32	0 (0%)			0.39	0.03	1.39	1.07
DEER ISLAND	16	0 (0%)			1.34	1.03	1.52	1.24
EVERETT	40	0 (0%)			0.66	0.10	1.10	0.78
FRAMINGHAM (c)	72	0 (0%)			0.08	0.23	1.25	1.18
LEXINGTON	36	0 (0%)			0.45	0.15	1.41	1.11
LYNNFIELD	6	0 (0%)			0.28	0.11	0.77	0.61
MALDEN	60	0 (0%)			0.80	0.78	0.97	0.93
MARBLEHEAD	24	0 (0%)			0.32	0.23	1.34	0.97
MARLBOROUGH (b)(c)	52	0 (0%)			0.09	0.21	1.12	1.12
MEDFORD	68	0 (0%)			0.21	0.24	1.28	0.96
MELROSE	36	0 (0%)			0.03	0.03	0.77	0.37
MILTON	32	0 (0%)			0.71	0.21	1.22	0.87
NAHANT	10	0 (0%)			0.17	0.03	0.73	0.56
NEEDHAM (b)	41	0 (0%)			0.04	0.02	0.36	0.41
NEWTON	88	0 (0%)			0.25	0.24	1.46	1.02
NORTHBOROUGH	16	0 (0%)			0.60	0.70	1.75	1.60
NORWOOD	36	0 (0%)			0.04	0.02	1.09	0.71
QUINCY	92	0 (0%)			0.02	0.16	1.21	1.07
REVERE	52	0 (0%)			0.65	0.15	1.41	1.03
SAUGUS	32	0 (0%)			1.35	0.98	1.44	1.16
SOMERVILLE	80	0 (0%)			0.07	0.03	1.24	0.87
SOUTHBOROUGH (c)	16	3 (18.75%)		yes	0.18	0.22	0.45	0.84
STONEHAM	28	0 (0%)			1.00	0.42	1.54	1.13
SWAMPSCOTT	18	0 (0%)			0.03	0.93	0.92	1.07
WAKEFIELD (b)	44	0 (0%)			0.25	0.22	0.88	0.74
WALTHAM	68	0 (0%)			0.04	0.01	1.21	0.82
WATERTOWN	40	0 (0%)			0.30	0.10	1.09	0.55
WELLESLEY (b)	36	0 (0%)			0.05	0.06	0.55	0.39
WESTBORO HOSPITAL	8	1 (12.5%)		no	0.10	0.14	0.46	0.65
WESTON (c)	16	0 (0%)			0.77	0.24	1.54	0.64
WINCHESTER (b)	20	0 (0%)			0.10	0.02	0.56	0.50
WINTHROP	24	0 (0%)			0.33	0.11	1.36	0.89
WOBURN (b)	60	0 (0%)			0.00	0.10	0.55	0.57
Total:	1677	4 (0.24%)						
MASS. WATER RESOURCES AUTHORITY (d)	616	0 (0%)			0.00	0.01	1.38	1.06

(a) The number of samples collected depends on the population served and the number of repeat samples required.

(b) These communities are partially supplied, and may mix their chlorinated supply with MWRA chloraminated supply.

(c) These communities locally chlorinate.

(d) MWRA sampling program includes a subset of community TCR sites as well as sites along the transmission system, tanks and pumping stations.

Treated Water - Disinfection By-Product (DBP) Levels in Communities









October 2004

Total Trihalomethanes (TTHMs) and Haloacetic Acids (HAAs) are by-products of disinfection treatment with chlorine. Chlorination levels, the presence of organic precursors, pH levels, the contact time of water with chlorine used for disinfection, and temperature all affect TTHM and HAA levels. DBPs are of concern due to their potential adverse health effects at high levels. EPA's running annual average standards are 80 ug/L for TTHMs and 60 ug/L for HAA5. DEP requires that compliance samples be collected quarterly. MWRA samples weekly at some locations, monthly and quarterly at others. **Metro Boston numbers are used for compliance purposes**; results presented below from CVA and MetroWest sampling sites enable MWRA staff to monitor control of MWRA treatment processes. Individual CVA and MetroWest communities are responsible for their own compliance monitoring and reporting. They must be contacted directly for their results.

The running annual average for TTHMs and HAA5s at compliance locations, represented in the top two graphs below, remained below current standards. Average monthly TTHM and HAA5 levels at all process control sampling locations for the MetroWest and Metropolitan Boston communities are similar to those of last year. The CVA system is monitored quarterly per DEP requirements.

TOTAL TRIHALOMETHANES

HALOACETIC ACIDS

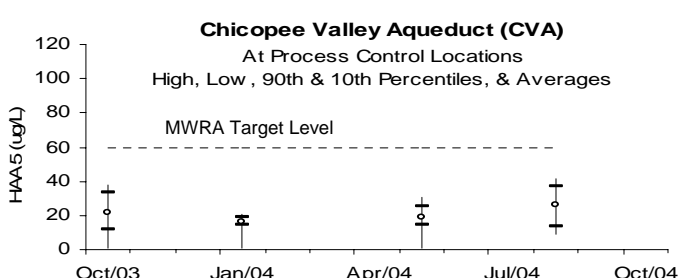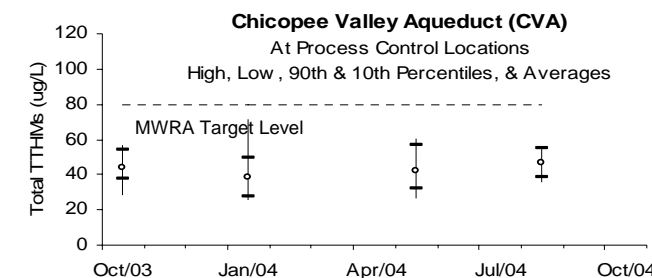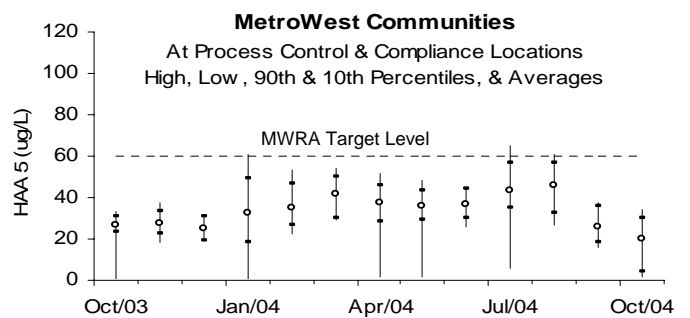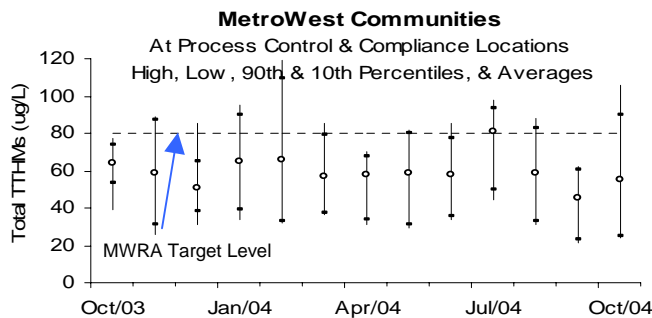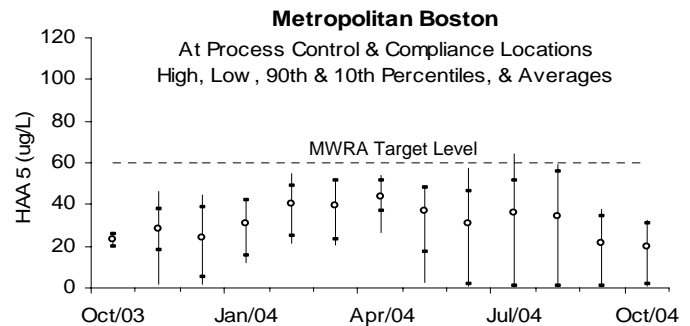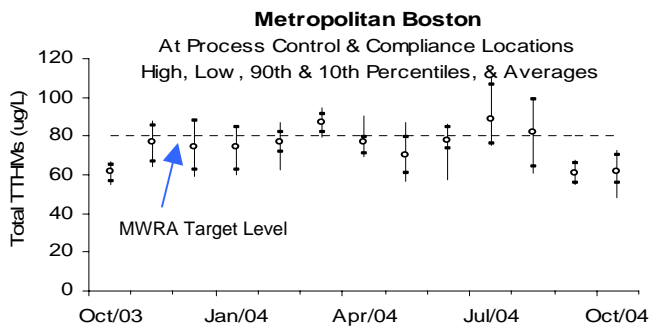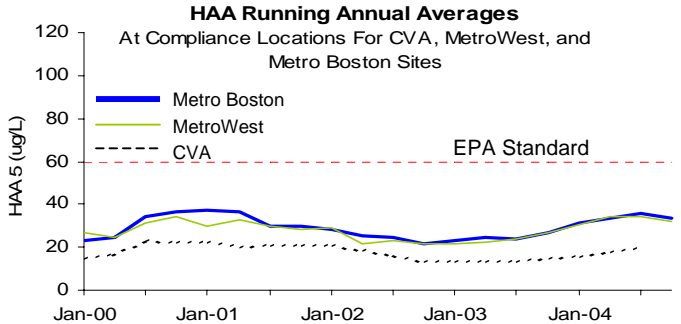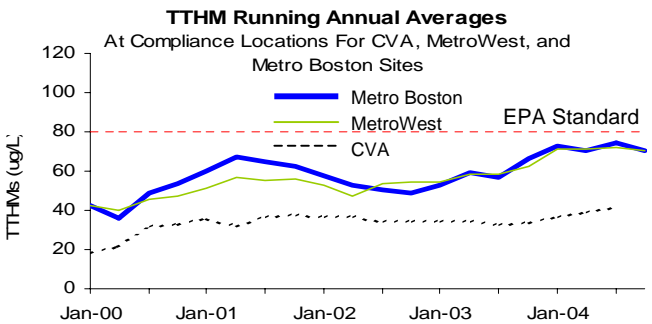

MWRA Monthly Water Quality Analysis

October 2004

This page provides information on water quality at six locations in the MWRA transmission system. Results reflect a "snapshot" in time and may not represent typical conditions. Elevated levels of a particular parameter may occur from time to time. MWRA staff review these numbers carefully and follow-up unusual results by re-analyzing samples, collecting new samples, or auditing sample sites. More rigorous daily or weekly monitoring of select parameters at these and other locations provides a better overall picture of water quality and is reported for some parameters elsewhere in this document. Monitoring for parameters indicated in bold is quarterly, as they either (1) have minimal variability or (2) are always below detection levels.

Component	CVA System		Metropolitan Boston				I Standards		Exceedance
	Quabbin Reservoir at Ware	Ludlow Monitoring Station	Wachusett Reservoir at Cosgrove	ICC Marlboro (Treated)	Comm Ave., Newton (Treated)	Shaft 9A, Malden (Treated)	Standard	Units	
Alkalinity	2.5	3.3	4.7	35.0	39.3	40.2		MG/L	
Aluminum	< 15.0	< 15.0	< 15.0	< 15.0	< 15.0	< 15.0	50-200 (e)	UG/L	NO
Ammonia-N	0.009	< 0.005	0.015	0.005	0.421	0.430		MG/L	
Antimony	< 0.9	< 0.9	< 0.9	< 0.9	< 0.9	< 0.9	6 (a)	UG/L	NO
Arsenic	< 0.8	< 0.8	< 0.8	< 0.8	< 0.8	< 0.8	50 (a)	UG/L	NO
Barium	7.3	7.5	9.3	9.1	9.5	9.3	2000 (a)	UG/L	NO
Beryllium	< 0.1	< 0.1	< 0.1	< 0.1	< 0.1	< 0.1	4 (a)	UG/L	NO
Bromate	< 2.5	< 2.5	< 2.5	< 2.5	< 2.5	< 2.5	10 (a)	UG/L	NO
Bromide	10.8	5.3	16.4	8.3	7.9	7.7		UG/L	
Cadmium	< 0.2	< 0.2	< 0.2	< 0.2	< 0.2	< 0.2	5 (a)	UG/L	NO
Calcium	2250	2330	4200	4150	4360	4350		UG/L	
Chloride	7.6	8.9	19.7	20.6	22.2	21.9	250 (e)	MG/L	NO
Chlorine, Free	NS	0.67	NS	0.19	NS	NS	4 (c)(d)	MG/L	NO
Chlorine, Total	NS	NS	NS	NS	1.76	1.89	4 (c)(d)	MG/L	NO
Chromium	< 0.9	< 0.9	< 0.9	< 0.9	< 0.9	< 0.9	100 (a)	UG/L	NO
Coliform, Fecal, MF Method	1	NS	1	NS	NS	NS	20 (b)	CFU/100 mL	NO
Coliform, Total, MF Method (h)	560*	0	0	0	0	0	100 (b) 0 (c)	CFU/100 mL	NO
Copper **	< 1.9	3.0	6.5	6.1	6.6	8.8	1300 (f) 1000 (g)	UG/L	NO
Cyanide	< 0.01	< 0.01	< 0.01***	< 0.01	< 0.01	< 0.01	0.2 (a)	MG/L	NO
Fluoride	0.12	0.06	0.04	0.85	0.94	0.92	4 (a)	MG/L	NO
Hardness	7.8	8.3	13.9	13.8	14.4	14.4		MG/L	
Iron **	10.0	9.9	20.7	22.7	28.6	23.2	300 (e)	UG/L	NO
Lead	< 1.2	< 1.2	< 1.2	< 1.2	< 1.2	< 1.2	15 (a)	UG/L	NO
Magnesium	565	584	876	866	873	882		UG/L	
Manganese	4.9	2.8	13.6	12.3	12.7	11.6	50 (e)	UG/L	NO
Mercury	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	< 0.01	2 (a)	UG/L	NO
Nickel	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0		UG/L	
Nitrate-N	0.005	0.007	0.031	0.045	0.048	0.046	10 (a)	MG/L	NO
Nitrite	< 0.005	< 0.005	< 0.005	< 0.005	< 0.005	< 0.005	1 (a)	MG/L	NO
Orthophosphate	< 0.003	< 0.003	< 0.003	0.005	0.005	0.004		MG/L	
pH	6.5	6.6	7.0	9.0	9.3	9.3		S.U.	
Potassium	448	440	778	774	833	797		UG/L	
Selenium	< 0.9	< 0.9	< 0.9	< 0.9	< 0.9	< 0.9	50 (a)	UG/L	NO
Silica (SiO2)	1450	1430	1550	2180	2260	2220		UG/L	
Silver	< 0.4	< 0.4	< 0.4	< 0.4	< 0.4	< 0.4	100 (e)	UG/L	NO
Sodium	4.6	5.5	10.9	24.8	28.1	27.7		MG/L	
Specific Conductance	49	54	100	159	173	174		UMHO/cm	
Standard Plate Count, HPC (48 Hrs @ 35C)	NS	NS	28	3	3	0	500 (c)	CFU/mL	NO
Sulfate (SO4)	5.0	5.0	6.2	6.2	6.1	6.2	250 (e)	MG/L	
Thallium	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	< 1.0	2 (a)	UG/L	NO
Total Dissolved Solids	40	40	69	95	101	100	500 (d)	MG/L	
Total Organic Carbon	1.9	2.0	2.1	2.2	2.1	2.1		MG/L	
Total Phosphorus	< 0.005	< 0.005	< 0.005	< 0.005	0.012	0.010		MG/L	
UV-254	0.023	0.018	0.044	0.036	0.025	0.025		A	
Zinc **	2.1	2.2	0.9	0.9	1.6	0.5	5000 (e)	UG/L	NO

(a) = Primary MCL standard (health related). DEP "Drinking Water Regulations", 310CMR 22.00.

(b) = Primary MCL standard (health related), applies to source (raw) water only. DEP "Drinking Water Regulations", 310CMR 22.00.

(c) = Primary MCL standard (health related). DEP "Drinking Water Regulations", 310CMR 22.00. Applies to samples of treated water downstream of Wachusett and Quabbin Reservoirs.

(d) = Maximum Residual Disinfectant Level. DEP "Drinking Water Regulations", 310CMR 22.00.

(e) = Secondary MCL standard (aesthetic related). DEP "Drinking Water Regulations", 310CMR 22.00.

(f) - Refers to 90th percentile Action Level

(g) - Refers to a single sample, secondary MCL

(h) - Confirmed results only are reported

MCL = Maximum Contaminant Level

CFU = Colony Forming Unit

S.U. = Standard Units

UG/L = micrograms per liter = parts per billion

NS = No sample

NTU = Nephelometric Turbidity Unit

MG/L = milligrams per liter = parts per million

< = less than method detection limit

HPC = Heterotrophic Plate Count

Inv Res = Invalid sample result

** = Metal results may be elevated due to local plumbing at the sample tap.

Most results are based on single grab samples collected on October 4 and 5, 2004 and analyzed by MWRA and contract laboratories.

NOTE: MWRA tests for cadmium and mercury are more sensitive than the EPA-set levels of detection and reporting. For cadmium any level below 1.0 ug/L and for mercury any level below 0.2 ug/L are under the EPA minimum detection limits. MWRA will continue to report any result below these detection limits here in the monthly report but will follow EPA reporting requirements and not report them in the EPA-regulated annual Consumer Confidence Report.

*According to the historical data for the Quabbin Reservoir, the high total coliforms appear to be a seasonal occurrence starting early August through late October.

The 4th quarter sample for cyanide was invalidated due to improper preservation. The result presented here is from the third quarter sample (collected in July 2004).