

MASSACHUSETTS WATER RESOURCES AUTHORITY  
100 First Avenue, Charlestown Navy Yard, Boston, MA 02129



## WATER QUALITY UPDATE

### An Analysis of December 2011 Sampling Data

For more information, please contact MWRA at (617) 242-5323, or visit [www.mwra.com](http://www.mwra.com).

## MWRA WATER QUALITY UPDATE

### December 2011 Highlights

•**MWRA has begun construction of a major modification to the Carroll Water Treatment Plant (serving metro Boston and Metro West communities) to add ultra violet light disinfection.** During construction, there will be periods of time when MWRA will continue to provide substantially more disinfection than currently required by regulation, but somewhat less than we have been providing. MWRA reports on both the required 3-log (99.9%) inactivation of *Giardia* (reported as CT) and the voluntary inactivation of *Cryptosporidium* (reported as PR). As part of this construction project, the UV equipment will be installed within the space of the extended ozone contactors. Thus, the contactors are being removed from service during half plant operations this winter, first the A-side, and then the B. When the extended contactors are no longer available, MWRA will not be able to fully meet our voluntary 2-log (99%) *Cryptosporidium* inactivation target.

The transition to a reduced disinfection target will occur around the beginning of February 2012. This change in treatment was reviewed and approved by the Massachusetts Department of Environmental Protection as part of its permitting for this project.

•**MWRA achieved CT disinfection requirements for the month** at the Ware Disinfection Facility and the Carroll Water Treatment Plant. CT results appear on Page 5. No community violated the Total Coliform Rule criteria. See Page 7.

•**Did you know** that MWRA's web site has an archive of Monthly Water Quality Updates from 2001 onward at <http://www.mwra.com/monthly/wqupdate/qual3wq.htm>?

We are continually updating the report. Let us know what you think (617) 242-5323

Call (617) 242-5323 or email [Joshua.Das@mwra.state.ma.us](mailto:Joshua.Das@mwra.state.ma.us)

Release Date: January 20, 2012

## Water Quality Update


This is a monthly report containing information about the quality of water supplied by MWRA. It provides a more detailed review of water quality than the annual water quality report that is mailed each June to customers in our service area. The report is available at [www.mwra.com](http://www.mwra.com).

## The Water System

The MWRA supplies wholesale water to local water departments in 51 communities, 45 in greater Boston and MetroWest, three in Western Massachusetts, and as a back-up supply for three others. Each municipality is responsible for distributing the water within its own community. More than two million people are served by the MWRA water supply system.

Quabbin Reservoir is the primary source of water for our system and one of the country's largest water supply impoundments, with a capacity of 412 billion gallons. Quabbin water represents source water for the Chicopee Valley Aqueduct (CVA) system. Water is transferred from Quabbin Reservoir to the 65 billion gallon Wachusett Reservoir in Clinton via the Quabbin Aqueduct. Wachusett water represents source water for MetroWest and Metropolitan Boston communities. The watershed areas of the Quabbin and Wachusett Reservoirs total 401 square miles. The Department of Conservation and Recreation (DCR), which manages the watersheds, and MWRA are committed to protection of the water supply through aggressive watershed protection as the first line of defense against water contamination. Three-quarters of the watersheds are protected lands and over 80% are either forest or wetlands.

The map below indicates the location of reservoirs, treatment facilities, and service communities.

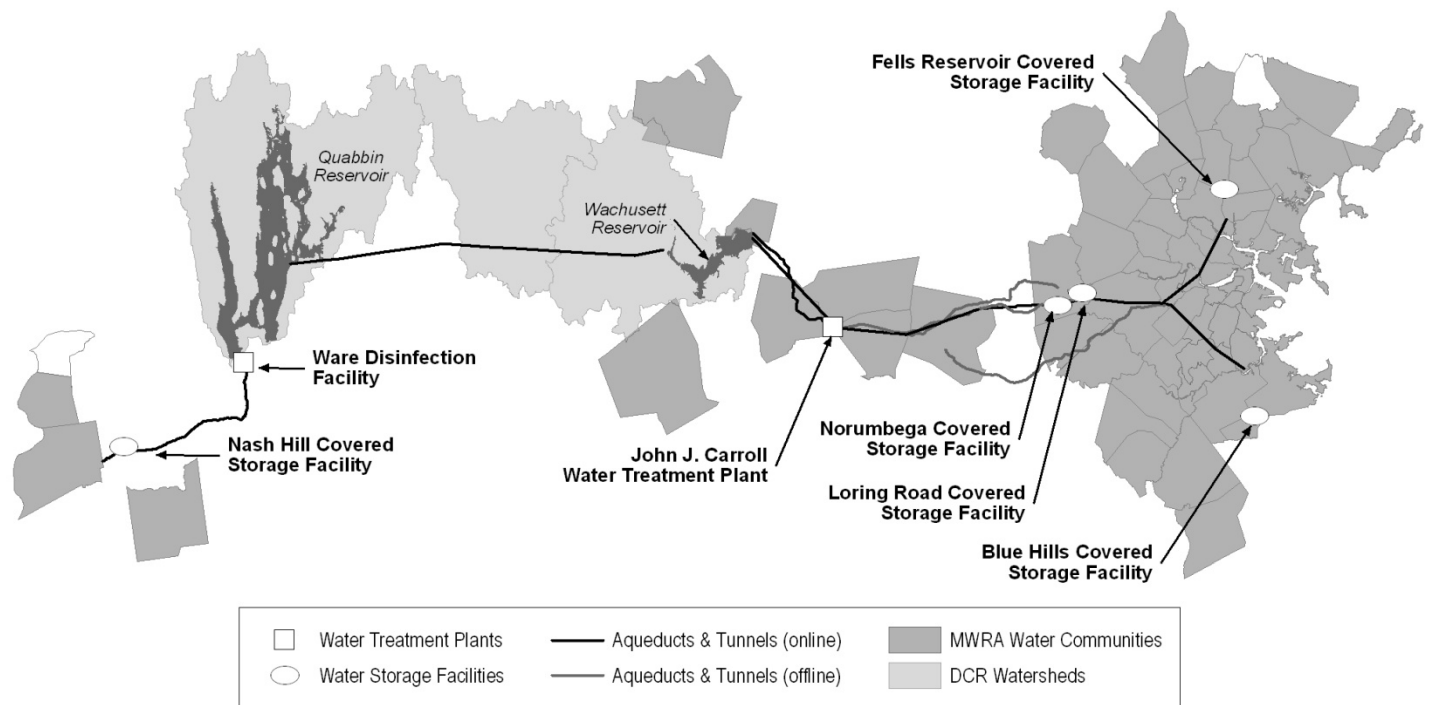

## Indicators of Water Quality

Tests are conducted on water sampled at the source reservoirs (source or "raw water") and also on water after treatment ("treated water"). MWRA routinely uses six general indicators of water quality: microbial, corrosiveness, disinfection by-products, turbidity and algae, disinfectant residual, and mineral analysis. Testing frequencies vary by parameter.

The Federal Safe Drinking Water Act (SDWA) sets standards for source and treated water quality. The standards relate to coliform, turbidity, watershed protection, disinfection and disinfection by-products, over 120 potential chemical contaminants, and waterborne disease outbreaks. MWRA monitors for these parameters on schedules ranging from daily to annually.

Customer communities must also meet certain standards under the SDWA concerning distribution of treated drinking water. The Total Coliform Rule (TCR) helps to alert communities to possible microbial contamination as well as the adequacy of residual disinfection within the local distribution system. MWRA tests over 2000 samples per month. Under the SDWA, a violation of the TCR occurs when greater than 5% of the samples in a community are positive for total coliform during a month.

# Source Water – Microbial Results

## December 2011



### Source Water - Microbial Results

Total coliform bacteria are monitored in both source and treated water to provide an indication of overall bacteriological activity. Most coliforms are harmless. However, fecal coliform, a subclass of the coliform group, are identified by their growth at temperatures comparable to those in the intestinal tract of mammals. They act as indicators of possible fecal contamination. The Surface Water Treatment Rule for unfiltered water supplies allows for no more than 10% of source water samples prior to disinfection over any six-month period to have more than 20 fecal coliforms per 100mL.

#### Sample Site: Quabbin Reservoir

Quabbin Reservoir water is sampled at the Ware Disinfection Facility (WDF) raw water tap before being treated and entering the CVA system.

Ten of the 31 samples were positive during December. None of the samples exceeded a count of 20 cfu/100ml. For the current six-month period, 0.0% of the samples have exceeded a count of 20 cfu/100mL.

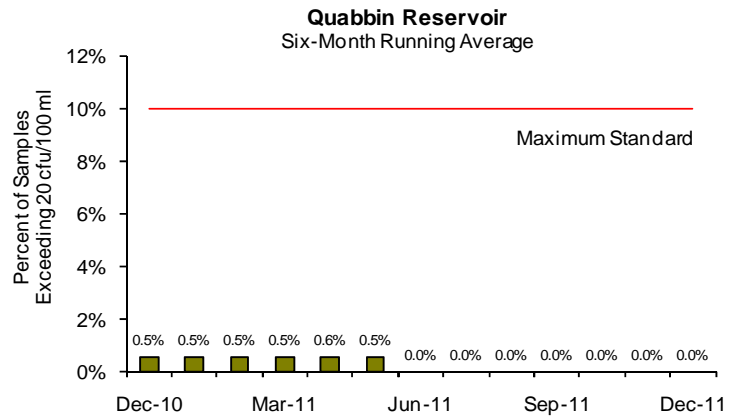
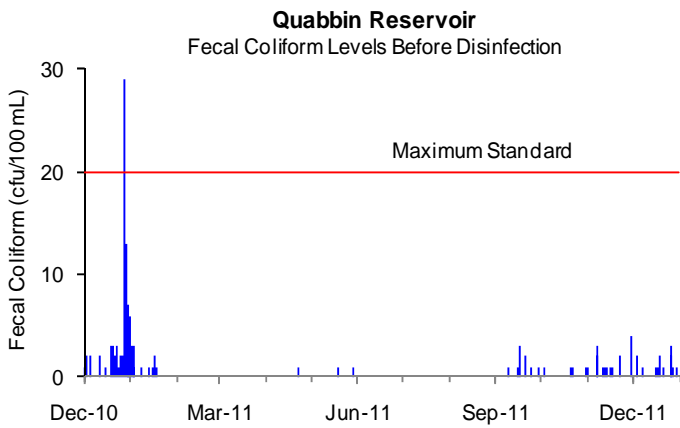


#### Sample Site: Wachusett Reservoir

Wachusett Reservoir water is sampled at the CWTP raw water tap in Marlborough before being treated and entering the MetroWest/Metropolitan Boston systems.

Fecal coliform levels tend to increase during the winter because, when water bodies near Wachusett ice over, waterfowl seek open water. Many roost at Wachusett, which tends to freeze later in the year than smaller ponds nearby.

Twenty-one of the 31 samples were positive during December. None of the samples exceeded a count of 20 cfu/100ml. For the current six-month period, 0.0% of the samples have exceeded a count of 20 cfu/100mL.

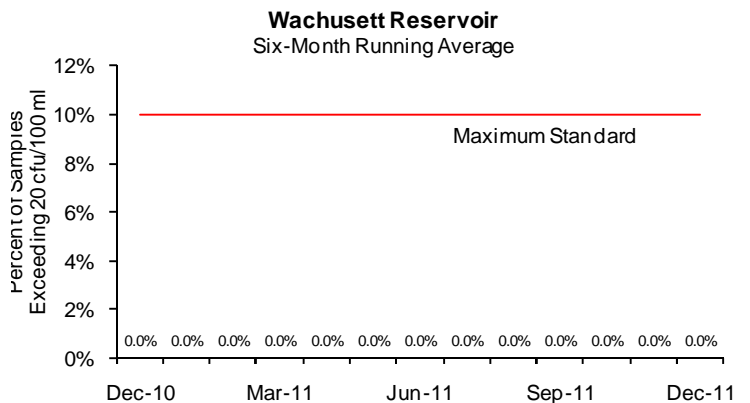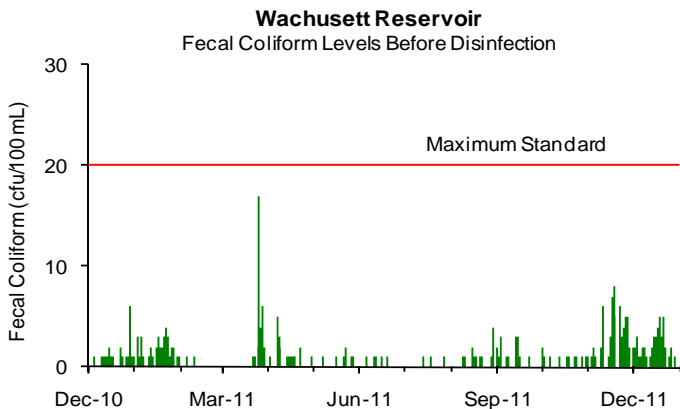



# Source Water – Turbidity and Algae Results December 2011

## Source Water – Turbidity Results

Turbidity is a measure of suspended and colloidal particles including clay, silt, organic and inorganic matter, algae and microorganisms. The effects of turbidity depend on the nature of the matter that causes the turbidity. High levels of particulate matter may have a higher chlorine demand or may protect bacteria from the disinfectant effects of chlorine, thereby, interfering with the disinfectant residual throughout the distribution system.

There are two standards for turbidity: all water must be below 5 NTU (Nephelometric Turbidity Units), and water can only be above 1 NTU if it does not interfere with effective disinfection.

Turbidity of Quabbin Reservoir water is monitored continuously at the Ware Disinfection Facility (WDF) before chlorination. Turbidity of Wachusett Reservoir is monitored continuously at the Carroll Water Treatment Plant (CWTP) before ozonation. Maximum turbidity results at Quabbin and Wachusett were within standards for the month.

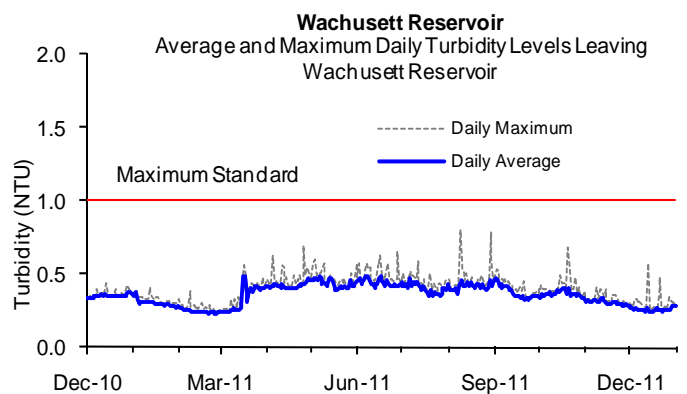
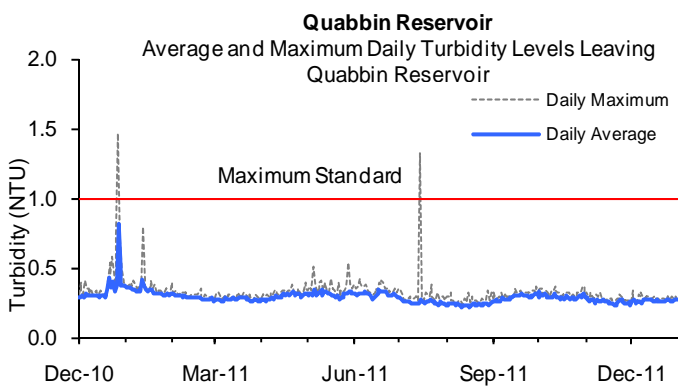


## Source Water – Algae Levels

Algae levels in Wachusett Reservoir are monitored by DCR and MWRA. These results, along with taste and odor complaints, are used to make decisions on source water treatment for algae control.

Taste and odor complaints at the tap may be due to algae, which originate in source reservoirs, typically in trace amounts. Occasionally, a particular species grows rapidly, increasing its concentration in water. When *Synura*, *Anabaena*, or other nuisance algae bloom, MWRA may treat the reservoir with copper sulfate, an algacide. During the winter and spring, diatom numbers may increase. While not a taste and odor concern, consumers using filters may notice more frequent changing of the filters is needed.

No complaints related to algae were reported during December from local water departments.

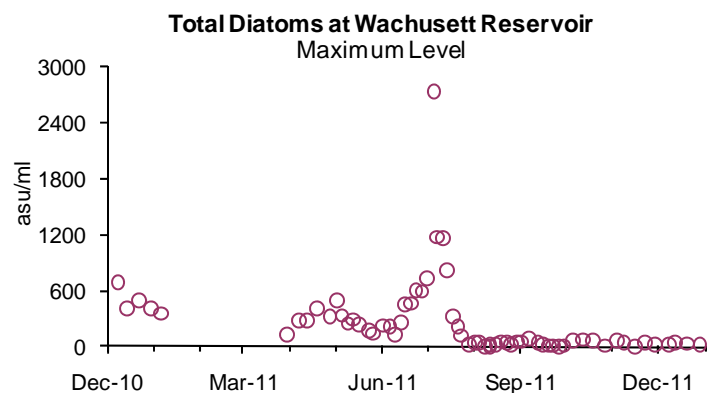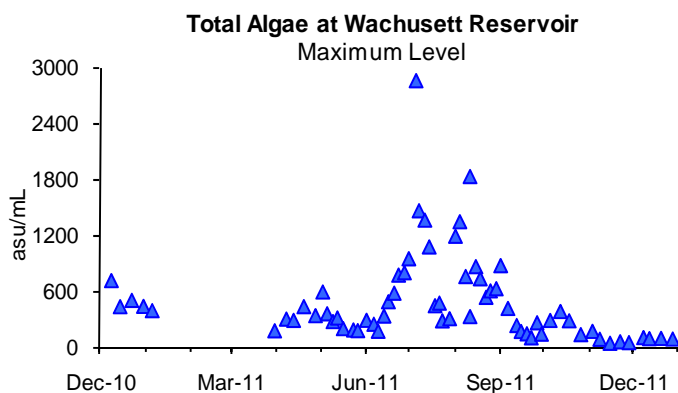

# Treated Water – Disinfection Results

## December 2011





### Treated Water - Primary Disinfection

At the Carroll Water Treatment Plant (CWTP), MWRA reports on both regulatory required 99.9% inactivation for *Giardia* (reported as “CT”), and its voluntary operating goal of 99% inactivation for *Cryptosporidium* (reported as “PR”). MWRA calculates hourly CT inactivation rates and reports daily CT inactivation rates at maximum flow, as specified by EPA regulations. The concentration (C) of the disinfectant over time (T) yields a measure of the effectiveness of disinfection. CT achievement for *Giardia* assures CT achievement for viruses, which have a lower CT requirement. The required CT for ozonated water varies with water temperature.

Compliance with the *Giardia* standard is expressed as percent of required CT achieved; 100% is the minimum allowed. To avoid confusion with the regulatory requirements, inactivation of *Cryptosporidium* is reported as Performance Ratio (PR). A PR of 1 demonstrates inactivation of 99% of *Cryptosporidium* based on site-specific data.

### Wachusett Reservoir – MetroWest/MetroBoston Supply:



- Ozone dose at the CWTP varied between 3.2 to 4.0 mg/L for December.
- *Giardia* CT was maintained above 100% at all times the plant was providing water into the distribution system for December; MWRA’s operating goal to meet a *Cryptosporidium* PR of 1 was met for every hour of the month.
- During UV construction work at CWTP, MWRA will be unable to meet its voluntary goal of a  $PR \geq 1$  at all times. See Highlights on Page 1.

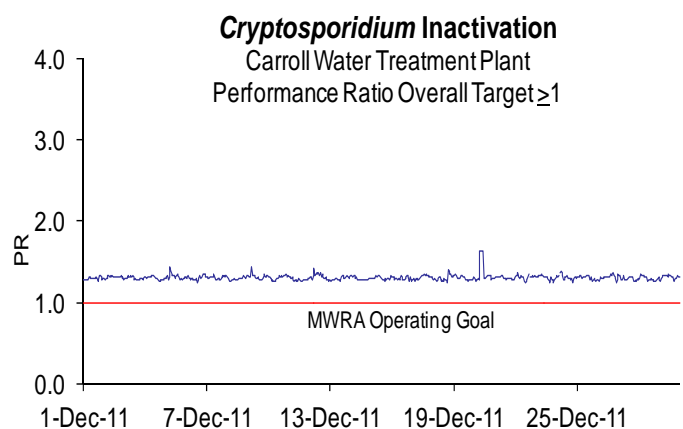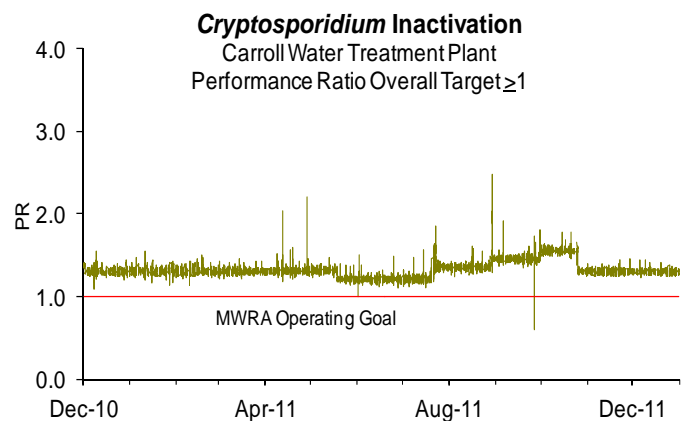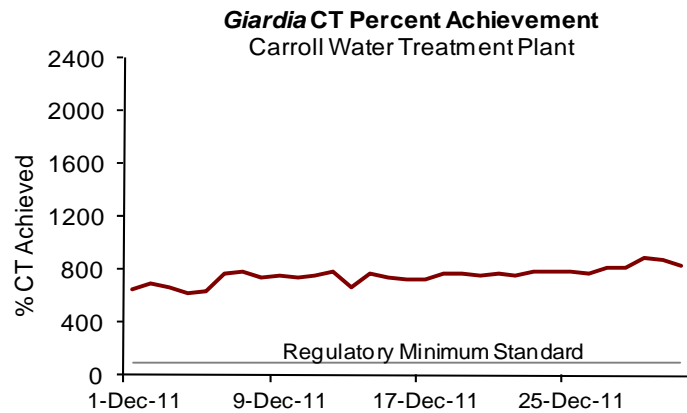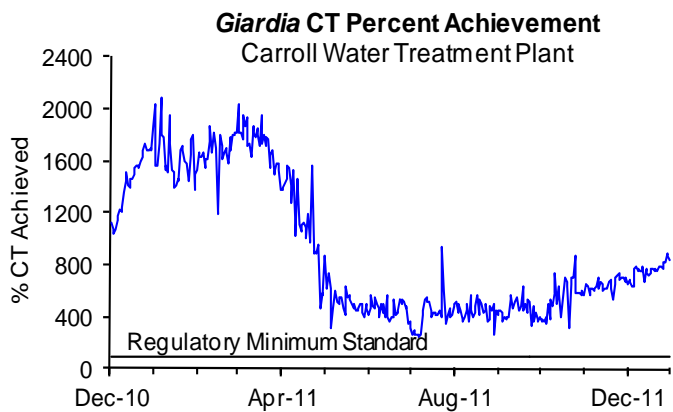

# Treated Water – Disinfection, pH and Alkalinity Results December 2011

## Quabbin Reservoir at Ware Disinfection Facility (CVA Supply):



*Giardia* CT was maintained above 100% at all times the plant was providing water into the distribution system for December. The chlorine dose at Ware Disinfection Facility (WDF) is adjusted in order to achieve MWRA's target of  $\geq 0.75$  mg/L at Ludlow Monitoring Station. The chlorine dose at WDF was 1.5 mg/L for December.

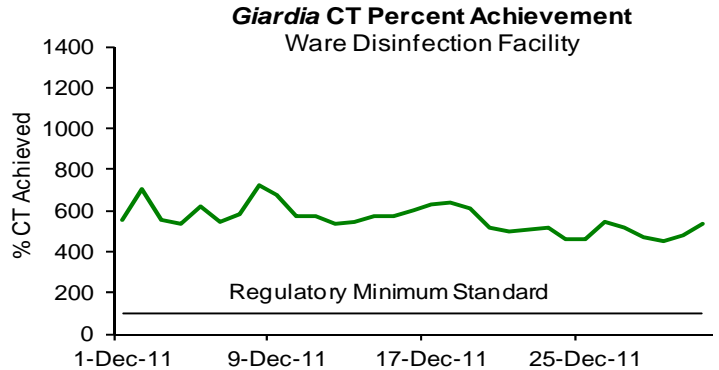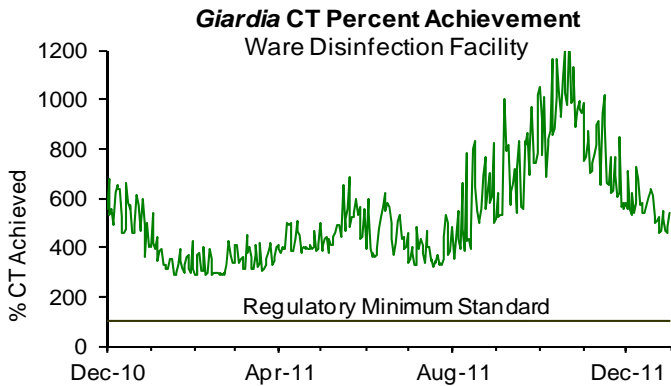

## pH and Alkalinity Compliance:

MWRA adjusts the alkalinity and pH of Wachusett water to reduce its corrosivity which minimizes the leaching of lead and copper from service lines and home plumbing systems into the water. MWRA's target for distribution system pH is 9.3; the target for alkalinity is 40 mg/L. Per DEP requirements, samples from the CWTP Fin B tap have a minimum compliance level of 9.1 for pH and 37 mg/L for alkalinity. Samples from 27 distribution system taps have a minimum compliance level of 9.0 for pH and 37 mg/L for alkalinity. Results must not be below this level for more than 9 days in a six-month period. MWRA tests finished water pH and alkalinity daily at the CWTP Fin B sampling tap. Distribution system samples are collected in March, June, September, and December. Distribution system samples were collected on December 14 and 15, 2011. Distribution system sample pH ranged from 9.1 to 9.6 and alkalinity ranged from 40 to 42 mg/L.

In December and over the past six-months, no sample results were below the target levels.

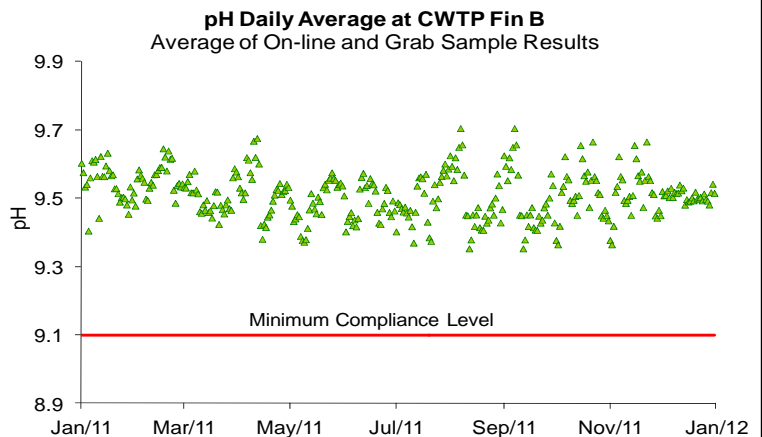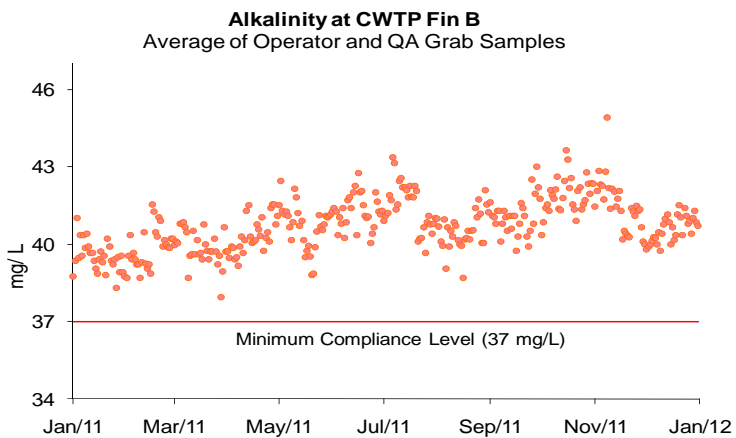

## Bacteria & Chlorine Residual Results for Communities in MWRA Testing Program December 2011

While all communities collect bacteria samples for the Total Coliform Rule (TCR), 42 systems (including Deer Island and Westboro State Hospital) use MWRA's Laboratory for TCR compliance testing. These systems collect samples for bacteriological analysis and measure water temperature and chlorine residual at the time of collection. The other 10 MWRA customer communities (including Lynn's GE plant) have their samples tested elsewhere and these towns should be contacted directly for their monthly results.

There are 139 sampling locations for which MWRA is required to report TCR results. These locations include a subset of the community TCR locations, as well as sites along MWRA's transmission system, water storage tanks and pumping stations.

The TCR requires that no more than 5% of all samples may be total coliform positive in a month (or that no more than one sample be positive when less than 40 samples are collected each month). Public notification is required if this standard is exceeded.

*Escherichia coli* (*E.coli*) is a specific coliform species that is almost always present in fecal material and whose presence likely indicates potential contamination of fecal origin. If *E.coli* are detected in a drinking water sample, this is considered evidence of a critical public health concern. Additional testing is conducted immediately and joint corrective action by DEP, MWRA, and the community is undertaken. Public notification is required if follow-up tests confirm the presence of *E.coli* or total coliform. A disinfectant residual is intended to maintain the sanitary integrity of the water; MWRA considers a residual of 0.2 mg/L a minimum target level at all points in the distribution system.

### Highlights

Two of the 1,892 community samples (0.1%) system-wide tested positive for confirmed total coliform during the month of December. None of the 647 MWRA samples (0.0%) tested positive for confirmed total coliform. No sample tested positive for *E.coli*. Westboro SH did not violate the TCR since only one sample was positive in their system which collects fewer than 40 samples/ month. All 42 systems that submitted chlorine residual data maintained an average disinfectant residual of at least 0.2 mg/L. Only 4.7% of the samples had results lower than 0.2 mg/L.

TCR results by Community								
Town	Samples Tested for Coliform (a)	Total Coliform # (%) Positive	<i>E.coli</i> % Positive	Public Notification Required?	December 2011 Minimum Chlorine Residual (mg/L)	December 2010 Minimum Chlorine Residual (mg/L)	December 2011 Average Chlorine Residual (mg/L)	December 2010 Average Chlorine Residual (mg/L)
ARLINGTON	56	0 (0%)	0.0%		0.07	0.01	1.65	1.73
BEDFORD	20	0 (0%)	0.0%		0.01		0.62	
BELMONT	32	0 (0%)	0.0%		0.39	1.14	1.53	1.87
BOSTON	253	0 (0%)	0.0%		0.24	0.65	2.19	2.25
BROOKLINE	68	0 (0%)	0.0%		0.08	0.05	1.93	2.05
CHELSEA	52	0 (0%)	0.0%		0.39	0.90	1.78	2.10
DEER ISLAND	16	0 (0%)	0.0%		1.77	2.02	2.01	2.17
EVERETT	40	0 (0%)	0.0%		1.01	0.59	1.10	1.12
FRAMINGHAM	73	0 (0%)	0.0%		0.22	0.30	1.84	1.92
HANSCOM AFB (Bedford) (b)	5	0 (0%)	0.0%		0.03	0.07	0.87	1.31
LEXINGTON	36	0 (0%)	0.0%		0.80	0.50	1.99	2.08
LYNNFIELD	6	0 (0%)	0.0%		0.21	0.49	0.69	1.34
MALDEN	61	0 (0%)	0.0%		1.30	1.30	1.46	1.38
MARBLEHEAD	24	0 (0%)	0.0%		0.17	0.23	1.48	1.78
MARLBOROUGH (b)	42	0 (0%)	0.0%		0.04	0.48	1.22	1.76
MEDFORD	68	0 (0%)	0.0%		0.58	0.86	1.71	1.83
MELROSE	36	0 (0%)	0.0%		0.01	0.02	0.79	0.78
MILTON	32	0 (0%)	0.0%		0.94	1.21	1.56	1.80
NAHANT	10	0 (0%)	0.0%		0.09	0.09	1.20	1.48
NEEDHAM (b)	41	0 (0%)	0.0%		0.04	0.08	0.57	0.73
NEWTON	92	0 (0%)	0.0%		0.21	0.32	1.68	1.91
NORTHBOROUGH (b)	16	0 (0%)	0.0%		0.02	0.05	1.18	1.00
NORWOOD	36	0 (0%)	0.0%		0.01	0.04	1.41	1.62
QUINCY	92	0 (0%)	0.0%		0.09	0.13	1.72	1.88
READING	40	0 (0%)	0.0%		0.02	0.06	1.12	1.67
REVERE	75	0 (0%)	0.0%		1.09	1.22	1.90	2.01
SAUGUS	32	0 (0%)	0.0%		1.34	1.61	1.80	2.00
SOMERVILLE	88	0 (0%)	0.0%		0.98	1.49	1.91	2.33
SOUTH HADLEY FD1 (c)	16	0 (0%)	0.0%		0.07	0.05	0.44	0.47
SOUTHBOROUGH	10	0 (0%)	0.0%		0.13	0.56	1.40	1.70
STONEHAM	35	0 (0%)	0.0%		0.21	1.42	1.91	2.21
SWAMPSCOTT	16	0 (0%)	0.0%		0.09	0.13	1.18	1.38
WAKEFIELD (b)	55	0 (0%)	0.0%		0.28	0.33	1.27	1.40
WALTHAM	75	1 (1.3%)	0.0%	No	0.17	1.20	1.74	2.20
WATERTOWN	50	0 (0%)	0.0%		0.69	0.43	1.92	1.85
WELLESLEY (b)	35	0 (0%)	0.0%		0.04	0.02	0.48	0.56
WESTBORO HOSPITAL	10	1 (10.0%)	0.0%	No	0.01	0.36	0.34	1.05
WESTON	16	0 (0%)	0.0%		1.22	1.54	1.93	1.93
WILMINGTON (b)	28	0 (0%)	0.0%		1.02	0.58	1.83	1.80
WINCHESTER (b)	20	0 (0%)	0.0%		0.19	0.15	0.95	0.86
WINTHROP	24	0 (0%)	0.0%		0.31	0.28	1.13	0.97
WOBURN (b)	60	0 (0%)	0.0%		0.20	0.07	1.05	0.83
<b>Total:</b>	<b>1892</b>	<b>2 (0.1%)</b>	<b>0.0%</b>					
MASS. WATER RESOURCES AUTHORITY (d,e)	647	0 (0%)	0.0%		0.02	0.05	1.89	1.99

(a) The number of samples collected depends on the population served and the number of repeat samples required.

(b) These communities are partially supplied, and may mix their chlorinated supply with MWRA chloraminated supply.

(c) Part of the Chicopee Valley Aqueduct System. Free chlorine system.

(d) MWRA sampling program includes a subset of community TCR sites as well as sites along the transmission system, tanks and pumping stations.

(e) MWRA total coliform and chlorine residual results include data from 125 community pipe locations as described above. In most cases these community results are accurately indicative of MWRA water as it enters the community system; however, some are clearly strongly influenced by local pipe conditions. Residuals in the MWRA system are typically between 1.0 and 2.8 mg/L.

# Treated Water - Disinfection By-Product (DBP) Levels in Communities






## December 2011

Total Trihalomethanes (TTHMs) and Haloacetic Acids (HAA5s) are by-products of disinfection treatment with chlorine. TTHMs and HAA5s are of concern due to their potential adverse health effects at high levels. EPA's running annual average (RAA) standard is 80 µg/L for TTHMs and 60 µg/L for HAA5s. The switch from chlorine to ozone for primary disinfection and the consolidation of treatment has lowered DBP formation and results are now more uniform. DEP requires that compliance samples be collected quarterly. Partially served communities are responsible for their own compliance monitoring and reporting and must be contacted directly for their results.

Absorbance, measured as UV-254, is one measurement of the amount and reactivity of natural organic material in source water. After Hurricane Irene, UV-254 measurements in Wachusett Reservoir rose sharply due to the action of the storm, increased tributary flows and above average fall precipitation. The higher UV-254 levels caused increased ozone and chlorine demand resulting in the need for higher ozone and chlorine doses. There were no impacts on regulatory compliance.

Bromate is tested monthly per DEP requirements for water systems that treat with ozone. Bromide in the raw water may be converted into bromate following ozonation. EPA's RAA Maximum Contaminant Level (MCL) standard for bromate is 10 µg/L.

The RAA for TTHMs and HAA5s for MWRA's Compliance Program (represented as the line in the top two graphs below) remain below current standards. The RAA for TTHMs = 6.7 µg/L; HAA5s = 8.7 µg/L. CVA's DBP levels continue to be below current standards. UV-254 levels are currently around 0.09 A/cm. The current RAA for Bromate = 0.0 µg/L.

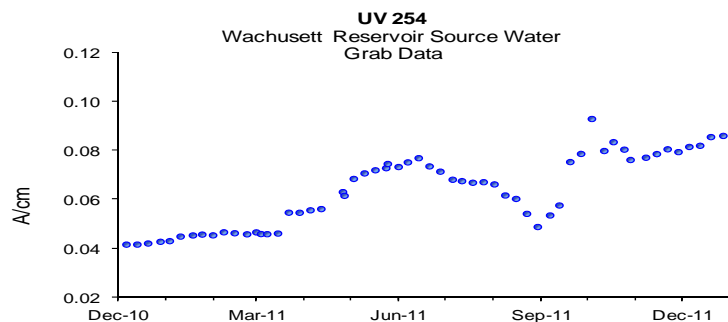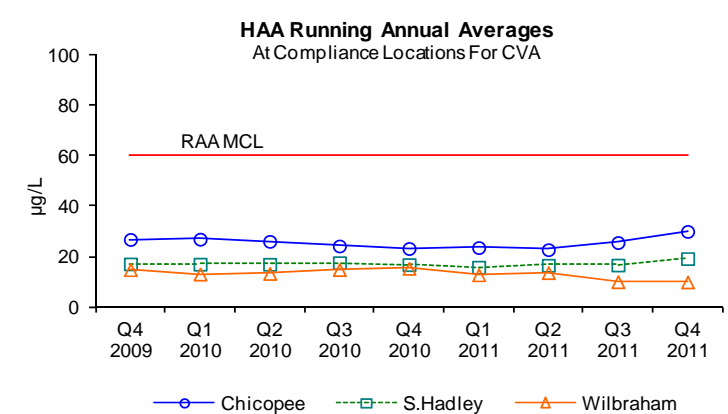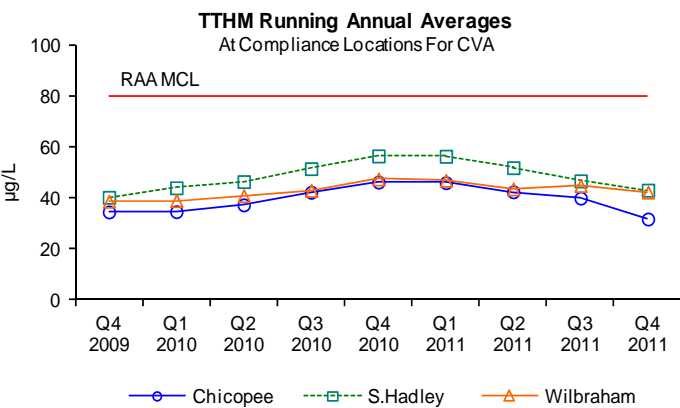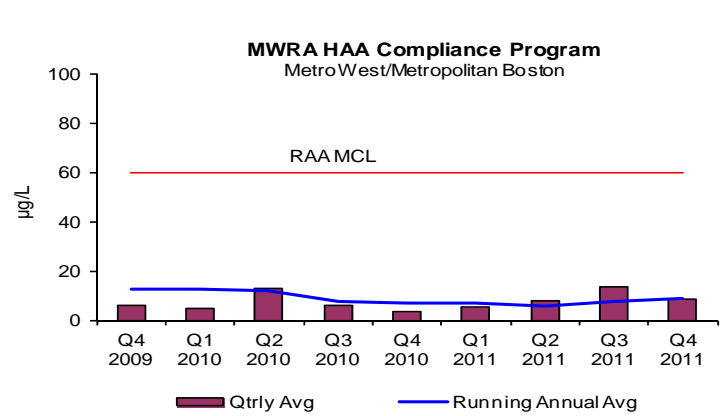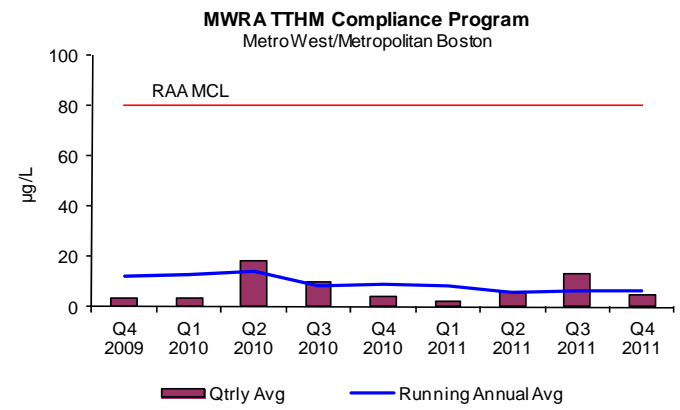



# MWRA Monthly Water Quality Analysis

## December 2011

This page provides information on water quality at four locations in the MWRA transmission system. Results reflect a "snapshot" in time and may not represent typical conditions. Monitoring for parameters indicated in bold is quarterly as they either have minimal variability or are always below detection limits. The "Wachusett System" locations represent raw water from the Wachusett Reservoir (CWTP inlet) and finished water leaving the treatment plant (CWTP Finished water tap). The "CVA System" locations represent raw water from the Quabbin Reservoir (WDF) and finished water after all treatment (LMS). See [www.mwra.com](http://www.mwra.com) for additional information on other parameters which are monitored less frequently.

CVA System
Wachusett System  
Metro-Boston
Standards

Component	Quabbin Res. at Ware Disinfection Facility (Raw)	Ludlow Monitoring Station (Treated)	Carroll Water Treatment Plant Inlet (Raw)	Carroll Water TP Fin. Water Tap B (Treated)	Health Standard	Aesthetics or Other Standards	Units	Method Reporting Limit
Alkalinity	<b>2.9</b>	<b>3.7</b>	<b>6.5</b>	<b>39.5</b>			MG/L	0.05
Aluminum	U	U	21.2	28.6		50-200 (c)	UG/L	15.0
Ammonia-N, Total	0.01	U	<b>0.01</b>	<b>0.49</b>			MG/L	0.005
Antimony	U	U	U	U	6 (b)		UG/L	0.4
Arsenic	U	U	U	U	10 (b)		UG/L	1.0
Barium	6.8	7.4	9.5	9.6	2000 (b)		UG/L	2.0
Beryllium	U	U	U	U	4 (b)		UG/L	0.3
Bromate	<b>U</b>	<b>U</b>	<b>U</b>	<b>U</b>	10 (b)		UG/L	5.0
Bromide	<b>9.8</b>	<b>5.4</b>	<b>16.5</b>	<b>18.0</b>			UG/L	5.0
Cadmium <sup>(1)</sup>	U	U	U	U	5 (b)		UG/L	0.5
Calcium	1940	2050	<b>4320</b>	<b>4560</b>			UG/L	20
Chloride	7.5	9.1	<b>21.8</b>	<b>24.8</b>		250 (c)	MG/L	0.5
Chlorine, Free		<b>0.89</b>			4 (b)(d)		MG/L	0.02
Chlorine, Total				<b>3.0</b>	4 (b)(d)		MG/L	0.02
Chromium, Total <sup>(5)</sup>	<b>U</b>	<b>U</b>	<b>U</b>	<b>U</b>	100 (b)		UG/L	1.0
Coliform, Fecal, MF Method	<b>U</b>		<b>1</b>		20 (a)		CFU/100 mL	1
Coliform, Total, MF Method <sup>(6)</sup>	<b>5</b>	<b>U</b>	<b>2</b>	<b>U</b>	100 (a) 0 (b)		CFU/100 mL	1
Copper **	3.3	3.5	<b>U</b>	<b>U</b>		1300 (f) 1000 (g)	UG/L	3.0
Cyanide	U	U	U	U	0.2 (b)		MG/L	0.01
Fluoride <sup>(3)</sup>	0.05	0.05	0.06	<b>0.99</b>	4 (b)		MG/L	0.02
Hardness <sup>(2)</sup>	6.8	7.2	13.8	13.6			MG/L	0.194
Iron **	14.8	12.4	<b>44.7</b>	<b>39.1</b>		300 (c)	UG/L	6.0
Lead	0.24	0.20	0.05	U		15 (f)	UG/L	0.05
Magnesium	481	512	803	785			UG/L	35
Manganese	4.96	3.97	<b>10.2</b>	<b>11.3</b>		50 (c)	UG/L	0.1
Mercury <sup>(1)</sup>	U	U	U	U	2 (b)		UG/L	0.05
Nickel	0.8	U	U	U			UG/L	0.5
Nitrate-N	U	U	0.046	0.061	10 (b)		MG/L	0.005
Nitrite	U	U	U	U	1 (b)		MG/L	0.005
Orthophosphate	U	U	<b>0.009</b>	<b>0.012</b>			MG/L	0.0025
pH	<b>6.6</b>	<b>6.9</b>	<b>6.9</b>	<b>9.6</b>			S.U.	
Potassium	476	508	924	924			UG/L	200
Selenium	U	U	U	U	50 (b)		UG/L	1.0
Silica (SiO2)	1590	1650	<b>3080</b>	<b>3900</b>			UG/L	200.0
Silver	U	U	U	U		100 (c)	UG/L	1.0
Sodium	5.0	6.1	<b>12.7</b>	<b>31.3</b>			MG/L	0.2
Specific Conductance	<b>47</b>	<b>52</b>	<b>113</b>	<b>192</b>			UMHO/cm	0.3
Standard Plate Count, HPC	<b>8</b>		<b>8</b>	<b>2</b>	500 (b)		CFU/mL	1
Sulfate (SO4)	4.5	4.5	<b>6.3</b>	<b>7.0</b>		250 (c)	MG/L	1.0
Thallium	U	U	U	U	2 (b)		UG/L	0.3
Total Dissolved Solids	35.0	37.0	66.0	95.0		500 (c)	MG/L	13
Total Organic Carbon	1.7	1.6	2.5	<b>2.5</b>			MG/L	0.3
Total Phosphorus	U	U	U	U			MG/L	0.05
UV-254	<b>0.023</b>	0.018	<b>0.082</b>	<b>0.039</b>			A/cm	0.000965
Zinc **	4.9	6.9	<b>U</b>	<b>U</b>		5000 (c)	UG/L	1.5

(a) = Primary MCL standard (health related), applies to source (raw) water only. DEP "Drinking Water Regulations", 310CMR 22.00.

(b) = Primary MCL standard (health related). DEP "Drinking Water Regulations", 310CMR 22.00. Applies to samples of treated water downstream of Wachusett and Quabbin Reservoirs. Most based on annual average.

(c) = Secondary MCL standard (aesthetic related). DEP "Drinking Water Regulations", 310CMR 22.00.

(d) = Maximum Residual Disinfectant Level. DEP "Drinking Water Regulations", 310CMR 22.00. Based on annual average.

(e) = Confirmed results only are reported.

(f) = Refers to 90th percentile Action Level.

(g) = Refers to a single sample, secondary MCL.

U = Less than method reporting limit

MCL = Maximum Contaminant Level

█ = Not Applicable

CFU = Colony Forming Unit

S.U. = Standard Units

UG/L = micrograms per liter = parts per billion

MG/L = milligrams per liter = parts per million

NTU = Nephelometric Turbidity Unit

HPC = Heterotrophic Plate Count (48 Hrs @ 35 °C)

\*\* = Metal results may be elevated due to local plumbing at the sample tap.

**Bold Italics = Samples from December**

Regular Font = Samples from October

Most results are based on single grab samples collected on December 5 and 6, 2011 and analyzed by MWRA and contract laboratories.

### NOTES:

(1) Due to MWRA lab equipment having higher sensitivity, MWRA's tests for several parameters are more sensitive than the EPA-set levels of detection and reporting. For example, the EPA minimum detection limit for cadmium is 1 ug/L and 0.2 ug/L for mercury, and MWRA lab tests and reports at lower than these detection limits.

(2) MWRA water is considered soft. Water is measured by hardness - which is the amount of dissolved minerals in the water. MWRA water has a hardness of about 15-20 mg/l or about 1 grain/gallon (1 grain/gallon = 17.1 mg/L). For comparison, hard water would have greater than 75 mg/l hardness.

(3) Fluoride dose is 1.0 mg/L with a desired range of 0.8 to 1.2 mg/L.